

**HITACHI**  
Inspire the Next

***VARIABLE FREQUENCY DRIVE***

# ***SJ700 & SJ700B*** ***series***


***Powerful Inverter  
with Sensorless Vector Control***



***For More Precise Control***



***For General Purpose Use***


 **Hitachi Industrial Equipment Systems Co., Ltd.**



## High starting Torque, Powerful Drive and easy setting

### High starting Torque

Improved Sensorless Vector Control and Auto Tuning produce high starting torque of 200% or more at 0.3Hz.\*1  
Easy setup of motor constants  
Ideal for applications which need high torque, such as cranes, extruders and lifts.

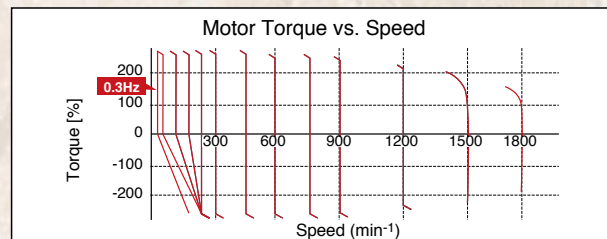

\*1 Starting torque

Series	Applicable motor	Starting torque
SJ700	0.4 to 55kW	0.3Hz/200%
	75 to 132kW	0.3Hz/180%
	185 to 400kW	0.3Hz/150%
SJ700B	11 to 75kW	0.5Hz/150%
	90 to 160kW	0.5Hz/120%


## Possible with SJ700 Series

### Hitachi exclusive 0Hz Domain sensorless vector control \*)

Develops 150%(SJ700B:120%)\*2 torque at 0Hz speed reference

Ideal for cranes and other applications that require high torque upon starting.

\*2 when inverter is one frame size larger than motor.




### Position Control Function \*)

The SJ700, with optional feedback board installed, together with an encoder-equipped motor can perform position control. For many applications, suitable performance can be achieved at a lower cost than servo systems.

Based on your four motion parameters (position command, speed command, acceleration time and deceleration time), the SJ700 will move an object from original position A to target position B.

After the movement, the inverter keeps hold motor position.


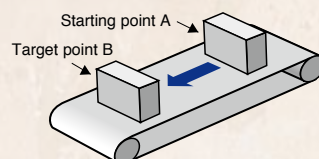


## Trip avoidance function

### Over current & voltage suppress function


Higher internal calculation speed improves current control performance.

Over-current suppress and Over-voltage suppress functions avoid inverter trips during acceleration and deceleration.

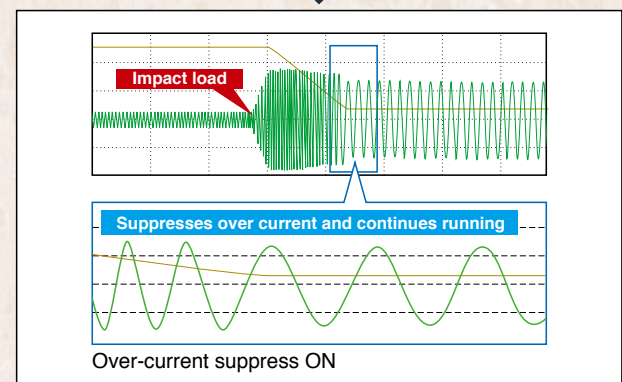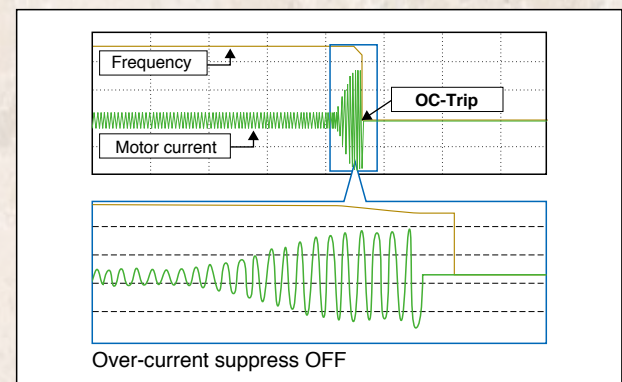

### DC Bus AVR Function During Deceleration

The SJ700 controls deceleration time so that the DC bus voltage does not exceed the over-voltage trip level, providing trip-less operation during deceleration.

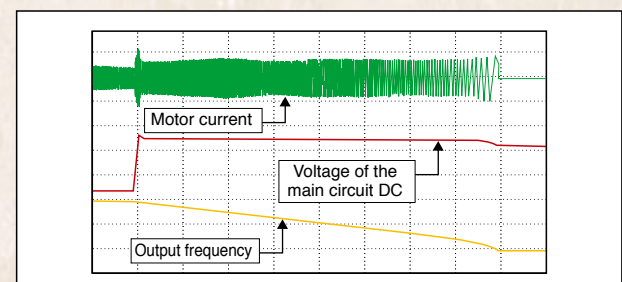



# High performance, powerful functions, yet user friendly.


## Programming [EzSQ: Easy Sequence] function

### Inverter control by Built-in Programming function

Sequence operation is realized by downloading to an inverter a program created with Hitachi's EzSQ software.

Tailor inverter operation to meet changing process requirements, and replace separate PLCs in some cases. By simplifying or eliminating external hardware, significant cost savings can be achieved.

Password function is incorporated to provide security for proprietary program data against loss or unauthorized modification.

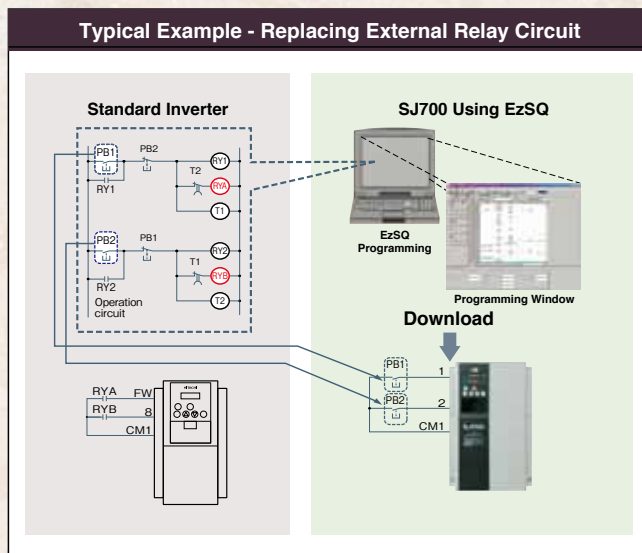

Item	Description	
Language Spec	Language type	BASIC Like
	Supported Device	Windows(DOS/V)OS:Windows2000, WindowsXP)
	Memory area	1,024 steps or 6k byte (Smaller of these)Program is stored in internal of inverter.
	Programming environment	Editor(Windows), Display(Windows) Syntax check(Windows) Program download/upload, All clear
	Executable format	Interpreter 2.0ms/command (Sub routine supported. 8 nested)
I/O function	External input	Contact signal/Open collector signal input (Internal DC24V power supply available)
		Program RUN command FW terminal is reserved
		General-purpose input Maximum of 8 point(X(00)-X(07))
	External analog input	XA(0) : 0-10V (O terminal)
		XA(1) : 4-20mA (OI terminal)
		XA(2) : 0-10V (O2 terminal)
External output	General-purpose output terminal	Maximum of 8 point(Y(00)-Y(05))
		YA(0) : Setup for FM terminal is possible.
	External analog output	YA(1) : Setup for AM terminal is possible.
		YA(2) : Setup for AMI terminal is possible.
Command	Programmable flow control <Loop, Unconditional jump, conditional jump, Time control, Sub routine, Others>	
	Operation command <+, -, *, /, substitution, mod, abs>	
	I/O control(Bit input, Word input, Bit output, Word output)	
	Timer control <on delay, off delay>	
	Inverter parameter setting	
Reserved word	Variable	User U(00)-U(31)/32 point
		Timer UL(00)-UL(07)/8 point
		Set frequency SET-Freq
		Acceleration time ACCEL
		Deceleration time DECEL
	Monitor	Output frequency, Output current, Rotation direction, PID feedback, Converted frequency, Output torque, Output voltage, Power, Cumulative RUN time, Cumulative power-on time, trip
		General-purpose input contact X(00)-X(07)/8 point
		General-purpose output contact Y(00)-Y(05)/6 point(1 point is relay output)
		Internal user UB(00)-UB(07)/8 point
		Internal timer contact TD(0)-TD(7)/8 point
		Inverter input and output In a remote operator display code.

★ Windows® is a registered trademark of Microsoft Corporation.U.S.A and other countries.

## EMC Filter & Brake circuit integrated as Standard

### Built-in EMC Filter up to 150kW\*

Cost and space reduction compared with external EMC Filter.

Reduces electromagnetic noise.


Meets EN61800-3 2nd-Environment

★ SJ700: European Version and Japanese Version does not have 150kW  
SJ700B: All models (5.5kW is without EMC Filter)

### Brake circuit up to 22kW\*

Cost and Space reduction compared with external Braking Controller.

★ SJ700B: Up to 30kW

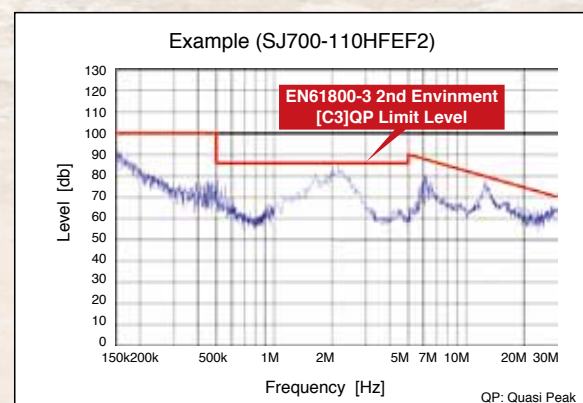

## Ease of Maintenance

### Easy-removable construction for maintenance


Field replacement of cooling fan(s) and DC bus capacitors can be accomplished in a fraction of the time.  
Using Logic terminal move to SJ700 without wiring change.  
Read SJ300 Parameter by SRW remote operator and write them in to SJ700



Easy-removable Cooling Fan



Easy-removable DC bus Capacitors (SJ700: above 15kW SJ700B: above 18.5kW)

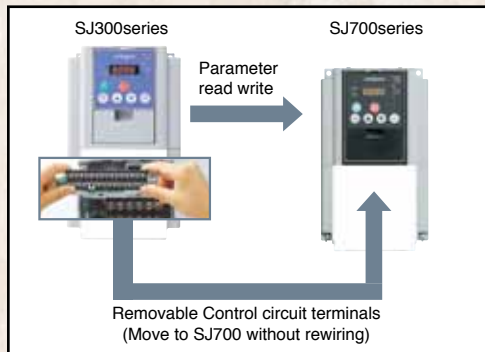

\*1 Control circuit terminals comparison table

Series	Input terminals	Output terminals
SJ700	9terminals (Intelligent 8terminals,FW)	5terminals (Open collector outputs)
SJ700B		
SJ300		
L300P	6terminals (Intelligent 5terminals,FW)	2terminals (Relay outputs)

### Long life time components & Life time warning function

#### Long life time components

Design lifetime 10 Years or more for DC bus capacitors & Cooling Fan.

Cooling Fan ON/OFF control function for longer fan life.

\*Ambient temperature: Average 40 deg C (SJ700B: 30 deg C)  
(no corrosive gases, oil mist or dust)

Design lifetime is calculated, and not guaranteed.

#### Life time warning function

Perform preventive maintenance before a failure occurs using the Lifetime Warning function.

DC bus capacitor, cooling fan, heat sink temperature and motor temperature can be monitored in order to replace components prior to failure.

## Easy Operation

### User selection of Displayed Parameters

#### Data comparison function


Allows display of only parameters changed from default.

#### User selected function

Display of up to 12 User Defined Parameters U001 to U012.

#### Basic mode (default)

Basic display mode for commonly used parameters.

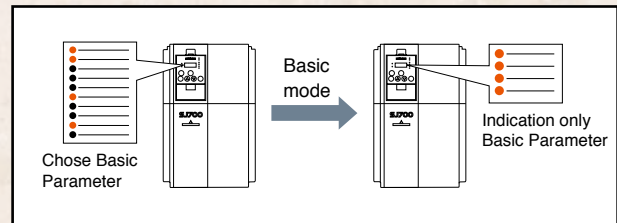

#### Other Functions

- The direct input of function code selection is possible rather than scrolling through the list.
- Holding down the function key for 3 seconds, causes the display to jump to output frequency monitor (d001) mode from any menu location.

## Network compatibility

A serial RS-485 Modbus-RTU port is standard.

The SJ700 can communicate with DeviceNet, PROFIBUS-DP, and other networks with communication options.

- DeviceNet is a trade mark of Open DeviceNet Vender Association, Inc.
- PROFIBUS-DP is a registered trade mark of PROFIBUS Nutzer Organization

Simple & Low cost wiring, Ease of installation and replacement





## Global standards

### Conformity to global standards

CE, UL, c-UL, C-Tick approvals.



### Logic input & output Terminal apply sink & source logic


### Wide Input power voltage range

Input voltage 240V for 200V class and 480V for 400V class as standard.

## Environmental Friendliness

### Micro Surge Voltage suppress function

Hitachi original PWM control method limits motor terminal voltage to less than two times of inverter DC bus voltage. Lower than Hitachi motor Max. insulation voltage (1,250V) (During regeneration, the motor terminal voltage may exceed the motor maximum insulation voltage (1,250V))

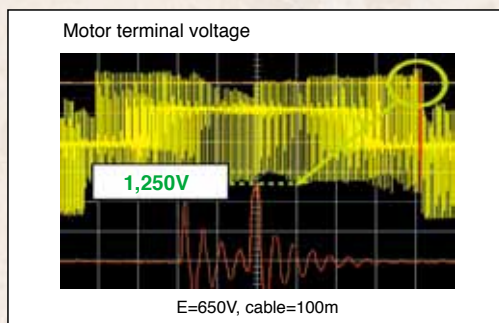

### EU RoHS compliant

EU RoHS compliant (except solder in power module)

### Improvement of environment

Varnish coating of internal PC board & plating of main circuit copper bus bar are standard.

## Versatile Functions

### Instantaneous Power Failure Disregard Function

The SJ700 override instantaneous power failure when power fluctuation happens frequently, as long as DC bus voltage remains higher than under-voltage trip level.

### Emergency stop

Shuts down the inverter by hardware, bypassing the CPU, to achieve a reliable, emergency stop function.

### Intelligent input terminal and output terminal ON/OFF delay function

Helps simplify external circuits.

### Active frequency matching function

Motor frequency match restart function operates effectively even without motor residual voltage.

### Controlled deceleration and stop on power loss

### Analog Input Disconnection Detection Function

The SJ700 (SJ700B) outputs a disconnection signal when frequency command through analog input is lost.

### Acceleration/Deceleration curve functions

The curve shape (five types, such as S-curve, etc.) can be chosen according to the application requirements.

### Analog Command Holding Function (AHD)

Output frequency can be changed with UP/DOWN Function, or with an analog signal as reference value. The set frequency at power shutdown can be saved, too.

### Pulse train input function

Pulse train input for Frequency reference or PID feed back signal, with SJ-FB (speed feed back card option).

### Integrated Input Electric Power monitor

Input electric power (kW) and Integrated input electric power for monitoring energy saving.

### Automatic Carrier Frequency Adjustment Function

The SJ700 detects motor current and automatically reduces carrier frequency according to the current.

### The resolution of analog outputs (voltage, current) is improved to 10 bits.



# STANDARD SPECIFICATIONS

## SJ700 Series

### ● 3-phase 200V class

Model SJ700-			JP Version	004LFF2	007LFF2	015LFF2	022LFF2	037LFF2	055LFF2	075LFF2	110LFF2	150LFF2	185LFF2	220LFF2	300LFF2	370LFF2	450LFF2	550LFF2
			US Version	004LFUF2	007LFUF2	015LFUF2	022LFUF2	037LFUF2	055LFUF2	075LFUF2	110LFUF2	150LFUF2	185LFUF2	220LFUF2	300LFUF2	370LFUF2	450LFUF2	550LFUF2
Enclosure (*1)			IP20															
Applicable motor (4-pole, kW(HP)) (*2)			0.4(1/2)	0.75(1)	1.5(2)	2.2(3)	3.7(5)	5.5(7.5)	7.5(10)	11(15)	15(20)	18.5(25)	22(30)	30(40)	37(50)	45(60)	55(75)	
Output Ratings	Rated capacity (kVA)	200V	1.0	1.7	2.6	3.6	5.7	8.3	11.0	15.9	22.1	26.3	32.9	41.9	50.2	63.0	76.2	
		240V	1.2	2.0	3.1	4.3	6.8	9.9	13.3	19.1	26.6	31.5	39.4	50.3	60.2	75.6	91.4	
	Rated output current (A)		3	5	7.5	10.5	16.5	24	32	46	64	76	95	121	145	182	220	
	Overload capacity(output current)		150%,60sec., 200%,3sec.															
	Rated output voltage (*3)		3-phase (3-wire) 200 to 240V (corresponding to input voltage)															
Input Rating	Rated input voltage (V)		3-phase 200 to 240V+10%, -15%, 50/60Hz±5%															
	Rated input current (A)		3.3	5.5	8.3	12	18	26	35	51	70	84	105	133	160	200	242	
Braking	Dynamic braking (Short-time) (*4)		Built-in BRD circuit (optional resistor)												External dynamic braking unit (option)			
	Minimum value of resistor (Ω)		50	50	35	35	35	16	10	10	7.5	7.5	5	-				
Vibration (*5)			5.9m/s <sup>2</sup> (0.6G), 10-55Hz												2.9m/s <sup>2</sup> (0.3G), 10-55Hz			
EMC filter			Built-in (EN61800-3 category C3)															
Zero-phase Reactor			Built-in															
Weight [kg] (lbs.)			3.5(7.7)	3.5(7.7)	3.5(7.7)	3.5(7.7)	3.5(7.7)	6(13.2)	6(13.2)	6(13.2)	14(30.8)	14(30.8)	14(30.8)	22(48.4)	30(66)	30(66)	43(94.6)	

### ● 3-phase 400V class

Model SJ700-			JP Version	007HFF2	015HFF2	022HFF2	037HFF2	055HFF2	075HFF2	110HFF2	150HFF2	185HFF2	220HFF2	300HFF2	370HFF2	450HFF2	550HFF2	
			European Version	007HFEF2	015HFEF2	022HFEF2	040HFEF2	055HFEF2	075HFEF2	110HFEF2	150HFEF2	185HFEF2	220HFEF2	300HFEF2	370HFEF2	450HFEF2	550HFEF2	
			US Version	007HFUF2	015HFUF2	022HFUF2	040HFUF2	055HFUF2	075HFUF2	110HFUF2	150HFUF2	185HFUF2	220HFUF2	300HFUF2	370HFUF2	450HFUF2	550HFUF2	
Enclosure (*1)				IP20														
Applicable motor (4-pole, kW(HP)) (*2)				0.75(1)	1.5(2)	2.2(3)	3.7(5) 4.0(5)	5.5(7.5)	7.5(10)	11(15)	15(20)	18.5(25)	22(30)	30(40)	37(50)	45(60)	55(75)	
Output Ratings	Rated capacity (kVA)	400V	1.7	2.6	3.6	6.2	9.7	13.1	17.3	22.1	26.3	33.2	40.1	51.9	63.0	77.6		
		480V	2.0	3.1	4.4	7.4	11.6	15.8	20.7	26.6	31.5	39.9	48.2	62.3	75.6	93.1		
	Rated output current (A)		2.5	3.8	5.3	9.0	14	19	25	32	38	48	58	75	91	112		
	Overload capacity(output current)		150%,60sec., 200%,3sec.															
	Rated output voltage (*3)		3-phase (3-wire) 380 to 480V (corresponding to input voltage)															
Input Rating	Rated input voltage (V)		3-phase 380 to 480V +10%, -15%, 50/60Hz±5%															
	Rated input current (A)		2.8	4.2	5.8	9.9	17	23	30	35	42	53	64	83	100	123		
Braking	Dynamic braking (Short-time) (*4)		Built-in BRD circuit (optional resistor)												External dynamic braking unit (option)			
	Minimum value of resistor (Ω)		100	100	100	70	70	35	35	24	24	20	-					
Vibration (*5)				5.9m/s²(0.6G), 10-55Hz												2.9m/s²(0.3G), 10-55Hz		
EMC filter				Built-in (EN61800-3 category C3)														
Zero-phase Reactor				Built-in														
Weight [kg] (lbs.)				3.5(7.7)	3.5(7.7)	3.5(7.7)	3.5(7.7)	6(13.2)	6(13.2)	6(13.2)	14(30.8)	14(30.8)	14(30.8)	22(48.4)	30(66)	30(66)	30(66)	

Model SJ700-			European Version	750HFEF2	900HFEF2	1100HFEF2	1320HFEF2	1850HFE2	2200HFE2	3150HFE2	4000HFE2
			US Version	750HFUF2	900HFUF2	1100HFUF2	1500HFUF2	1850HFU2	2200HFU2	3150HFU2	4000HFU2
			JP Version	750HFF2	900HFF2	1100HFF2	1320HFF2	1850HF2	2200HF2	3150HF2	4000HF2
Enclosure (*1)				IP00							
Applicable motor (4-pole, kW(HP)) (*2)				75(100)	90(125)	110(150)	132(175)	185(250)	220(300)	315(400)	400(550)
Output Ratings	Rated capacity (kVA)	400V	103.2	121.9	150.3	180.1	256	305	416	554	
		480V	123.8	146.3	180.4	216.1	308	366	499	665	
	Rated output current (A)		149	176	217	260	370	440	600	800	
	Overload capacity(output current)		150%,60sec., 200%,0.5sec.					150%,60sec., 180%,0.5sec.			
	Rated output voltage (*3)		3-phase (3-wire) 380 to 480V (corresponding to input voltage)								
Input Rating	Rated input voltage (V)		3-phase 380 to 480V +10%, -15%, 50/60Hz±5%								
	Rated input current (A)		164	194	239	286	389	455	630	840	
Braking	Dynamic braking (Short-time) (*4)		External dynamic braking unit (option)								
	Minimum value of resistor (Ω)		-								
Vibration (*5)				2.9m/s²(0.3G), 10-55Hz				1.96m/s²(0.2G), 10-55Hz			
EMC filter				Built-in (EN61800-3 category C3)				External Option			
Zero-phase Reactor				Built-in				External Option			
Weight [kg] (lbs.)				60(132)	60(132)	80(176)	80(176)	140(308)	145(319)	210(462)	360(792)

# STANDARD SPECIFICATIONS

## SJ700B Series

### ● 3-phase 400V class

Model SJ700B-			Asia Version	055HFF	075HFF	110HFF	150HFF	185HFF	220HFF	300HFF	370HFF	450HFF	550HFF	750HFF	900HFF	1100HFF	1320HFF	1600HFF
			US Version	－	075HFUF	110HFUF	150HFUF	185HFUF	220HFUF	300HFUF	370HFUF	450HFUF	550HFUF	750HFUF	900HFUF	1100HFUF	1320HFUF	1600HFUF
Enclosure (*1)			IP20											IP00				
Applicable motor (4-pole, kW(HP)) (*2)			5.5(75)	7.5(10)	11(15)	15(20)	18.5(25)	22(30)	30(40)	37(50)	45(60)	55(75)	75(100)	90(125)	110(150)	132(150)	160(220)	
Output Ratings	Rated capacity (kVA)	400V	9.7	11	15.2	20.0	25.6	29.7	39.4	48.4	58.8	72.7	93.5	110.8	135.1	159.3	200.9	
		480V	11.6	13.3	18.2	24.1	30.7	35.7	47.3	58.1	70.6	87.2	112.2	133	162.1	191.2	241.1	
	Rated output current (A)		14	16	22	29	37	43	57	70	85	105	135	160	195	230	290	
	Overload capacity(output current)		120%,60sec															
	Rated output voltage (*3)		3-phase (3-wire) 380 to 480V (corresponding to input voltage)															
Input Rating	Rated input voltage (V)		3-phase 380 to 480V +10%, -15%, 50/60Hz±5%															
	Rated input current (A)		17	18	24	32	41	47	63	77	94	116	149	176	199	253	300	
Braking	Dynamic braking (Short-time) (*4)		Built-in BRD circuit (optional resistor)							External dynamic braking unit (option)								
	Minimum value of resistor (Ω)		70	70	35	35	24	24	20	－								
Vibration (*5)			5.9m/s²(0.6G), 10-55Hz							2.9m/s²(0.3G), 10-55Hz								
EMC filter			－	Built-in (EN61800-3 category C3)														
Zero-phase Reactor			－	Built-in														
Weight (lbs.)			3.5(7.7)	6(13.2)	6(13.2)	6(13.2)	14(30.8)	14(30.8)	14(30.8)	22(48.4)	30(66)	30(66)	30(66)	55(121)	55(121)	70(154)	70(154)	

### ● 3-phase 200V class

Model SJ700B-			US Version	110LFUF	150LFUF	185LFUF	220LFUF	300LFUF	370LFUF	450LFUF	550LFUF	750LFUF
Enclosure (*1)				IP20								
Applicable motor (4-pole, kW(HP)) (*2)				11(15)	15(20)	18.5(25)	22(30)	30(40)	37(50)	45(60)	55(75)	75(100)
Output Ratings	Rated capacity (kVA)	200V	15.2	20.0	25.2	29.4	39.1	48.4	58.5	72.7	93.5	
		240V	18.2	24.1	30.3	35.3	46.9	58.1	70.2	87.2	112.2	
	Rated output current (A)		44	58	73	85	113	140	169	210	270	
	Overload capacity(output current)		120%,60sec									
	Rated output voltage (*3)		3-phase (3-wire) 200 to 240V (corresponding to input voltage)									
Input Rating	Rated input voltage (V)		3-phase 200 to 240V +10%, -15%, 50/60Hz±5%									
	Rated input current (A)		48	64	80	94	120	150	186	240	280	
Braking	Dynamic braking (Short-time) (*4)		Built-in BRD circuit (optional resistor)						External dynamic braking unit (option)			
	Minimum value of resistor (Ω)		10	10	7.5	7.5	7.5	-				
Vibration (*5)				5.9m/s²(0.6G), 10-55Hz						2.9m/s²(0.3G), 10-55Hz		
EMC filter				Built-in (EN61800-3 category C3)								
Zero-phase Reactor				Built-in								
Weight (lbs.)				6(13.2)	6(13.2)	14(30.8)	14(30.8)	14(30.8)	22(48.4)	30(66)	30(66)	43(94.6)

\*1: The protection method conforms to JIS C 0920(IEC60529)

\*2: The applicable motor refers to Hitachi standard 3-phase motor (4-pole).To use other motors, be sure to prevent the rated motor current (50Hz) from exceeding the rated output current of the inverter.

\*3: The output voltage decreases as the main power supply voltage decreases except for the use of AVR function.

\*4: Braking resistor is not integrated in the inverter. Please install optional braking resistor or dynamic braking unit when large braking torque is required.

\*5: Conforms to the test method specified in JIS C 60068-2-6 : 2010 (IEC 60068-2-6 : 2007).

\*6: To operate the motor beyond 50/60Hz, please consult with the motor manufacturer about the maximum allowable rotation speed.

\*7: Storage temperature refers to the temperature in transportation.

\*8: The frequency command is the maximum frequency at 9.8V for input voltage 0 to 10VDC, or at 19.8mA for input current 4 to 20mA.

If this characteristic is not satisfactory for your application,contact your Hitachi representative.

## Model Name Indication

### SJ700 series

Series Name \_\_\_\_\_  
Applicable Motor Capacity 004: 0.4kW(1/2HP)  
4000:400kW(500HP)  
Power Source L: 3-phase 200V class  
H: 3-phase 400V class  
F: With keypad  
U : US version  
E : European version  
Note: Japanese version  
F: Integrated EMC filter  
Version \_\_\_\_\_

### SJ700-055HFF2

### SJ700B series

Series Name \_\_\_\_\_  
Applicable Motor Capacity 055: 5.5kW(7.5HP)  
1600:160kW(220HP)  
Power Source L: 3-phase 200V class  
H: 3-phase 400V class  
F: With keypad  
U : US version  
Note: Asia version  
F: Integrated EMC filter  
Version \_\_\_\_\_

### SJ700B-110HFUF

## Model Configuration

● Available

Applicable Motor kW (HP)			0.4 (1/2)	0.75 (1)	1.5 (2)	2.2 (3)	3.7 (5)	4.0 (5)	5.5 (7.5)	7.5 (7.5)	11 (15)	15 (20)	18.5 (25)	22 (30)	30 (40)	37 (50)	45 (60)	55 (75)	75 (100)	90 (125)	110 (150)	132 (175)	150 (200)	160 (220)	185 (250)	220 (300)	315 (400)	400 (550)	
SJ700	3-phase 200V	LFUF2	●	●	●	●	●		●	●	●	●	●	●	●	●	●	●											
		LFF2	●	●	●	●	●		●	●	●	●	●	●	●	●	●	●	●										
	3-phase 400V	HFEF2		●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●				●	●	●	●
		HFUF2		●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●		●		●	●	●	●
		HFF2		●	●	●	●		●	●	●	●	●	●	●	●	●	●	●	●	●	●	●			●	●	●	●
SJ700B	3-phase 200V	LFUF									●	●	●	●	●	●	●	●	●	●									
	3-phase 400V	HFF						● <sup>*1</sup>	●	●	●	●	●	●	●	●	●	●	●	●	●	●		●					
	3-phase 400V	HFUF																							●				

\*1 Available only for Asia version. without EMC Filter



# SPECIFICATIONS

## ● General Specifications

Items			General Specifications	
Control	Control method		Line to line sine wave pulse-width modulation (PWM) control	
	Output frequency range (*6)		0.1-400.0Hz(400kW:0.1-120Hz)	
	Frequency accuracy		Digital: ±0.01% of the maximum frequency, Analog: ±0.2%(25±10°C)	
	Frequency resolution		Digital setting: 0.01Hz, Analog setting: (Maximum frequency)/4,000 (O terminal: 12bit 0-10V, O2 terminal: 12bit -10--+10V)	
	V/f characteristics		V/f optionally variable (30-400Hz of base frequency), V/f control (constant torque, reduced torque), Sensorless vector control, 0Hz domain sensorless vector control, vector control (SJ-FB card option)	
	Speed fluctuation		±0.5% (sensorless vector control)	
	Acceleration/deceleration time		0.01-3,600sec. (Linear/curve, accel./decel. selection), Two-stage accel./decel.	
	Starting Torque		SJ700 (Sensorless vector control): 200% at 0.3Hz/ 75kW to 150kW:180% at 0.3Hz,185kW and over:150% at 0.3Hz. SJ700B (Sensorless vector control): 150% at 0.5Hz/ 90kW and over:120% at 0.5Hz, SJ700 (0Hz domain with motor one frame size down):150% at around 0Hz/ 75kW and over: 130% at around 0Hz.	
	Carrier frequency range		SJ700: 0.5-15.0kHz(185kW and over:0.5-3.0kHz)/SJ700B: 0.5-12.0kHz(90kW and over:0.5-8.0kHz)	
DC braking			Performs at start: under set frequency at deceleration, via an external input (braking force, time, and operating frequency).	
Input signal	Frequency setting	Operator	Up and Down keys	
		External signal*8	DC 0-10V, -10--+10V (input impedance 10kΩ), 4-20mA (input impedance 100Ω)	
		External port	Setting via RS485 communication	
	Forward /reverse Start /stop	Operator	Start/stop commands (forward/reverse switching by parameter setting)	
		External signal	Forward-operation start/stop commands (reverse-operation start/stop possible when relevant commands are assigned to intelligent input terminals)3-wire input possible (when relevant commands are assigned to control circuit terminals)	
		External port	Setting via RS485 communication	
	Intelligent input terminals	Terminals	8 terminals, NO/NC switchable, sink logic/source logic switchable	
		Functions	Reverse operation (RV), Multi-speed 1 setting (CF1), Multi-speed 2 setting (CF2), Multi-speed 3 setting (CF3), Multi-speed 4 setting (CF4), Jogging (JG), external DC braking (DB), 2nd motor control (SET), 2-stage acceleration/deceleration (2CH), free-run stop (FRS), external trip (EXT), unattended start protection (USP), commercial power supply switching (CS), software lock (SFT), analog input switching (AT), 3rd motor control (SET3), reset (RS), starting by 3-wire input (STA), stopping by 3-wire input (STP), forward/reverse switching by 3-wire input (F/R), PID disable (PID), PID integration reset (PIDC), control gain switching (CAS), acceleration by remote control (UP), deceleration by remote control (DWN), data clearance by remote control (UDC), forcible operation (OPE), Multi-speed bit 1 (SF1), Multi-speed bit 2 (SF2), Multi-speed bit 3 (SF3), Multi-speed bit 4 (SF4), Multi-speed bit 5 (SF5), Multi-speed bit 6 (SF6), Multi-speed bit 7 (SF7), overload restriction selection (OLR), torque limit selection (enabling/disabling) (TL), torque limit 1 (TRQ1), torque limit 2 (TRQ2), P/PI switching (PPI), braking confirmation (BOK), orientation (ORT), LAD cancellation (LAC), clearance of position deviation (PCLR), permission of 90° shift phase (STAT), trigger for frequency addition (A145) (ADD), forcible-terminal operation (F-TM), permission of torque command input (ATR), cumulative power clearance (KHC), servo-on (SON), pre-excitation (FOC), general-purpose input 1 (MI1), general-purpose input 2 (MI2), general-purpose input 3 (MI3), general-purpose input 4 (MI4), general-purpose input 5 (MI5), general-purpose input 6 (MI6), general-purpose input 7 (MI7), general-purpose input 8 (MI8), analog command holding (AHD), Multistage position settings selection 1 (CP1), Multistage position settings selection 2 (CP2), Multistage position settings selection 3 (CP3), Zero-return limit function (ORL), Zero-return trigger function (ORG), Forward drive stop (FOT), reverse drive stop (ROT), Speed / position switching (SPD), Pulse counter (PCNT), Pulse counter clear (PCC), Emergency stop (EMR) ,no assignment (no)	
		Thermistor input		1 terminal (PTC characteristics)
		Output signal	Intelligent output terminals	Terminals
Functions	Running (RUN), constant-speed reached (FA1), set frequency overreached (FA2), overload notice advance signal (1) (OL), output deviation for PID control (OD), alarm signal (AL), set frequency reached (FA3), over-torque (OTQ), instantaneous power failure (IP), undervoltage (UV), torque limited (TRQ), operation time over (RNT), plug-in time over (ONT), thermal alarm signal (THM), brake release (BRK), braking error (BER), 0Hz detection signal (ZS), speed deviation maximum (DSE), positioning completed (POK), set frequency overreached 2 (FA4), set frequency reached 2 (FA5), overload notice advance signal (2) (OL2), PID feedback comparison (FBV), communication line disconnection (NDc), logical operation result 1 (LOG1), logical operation result 2 (LOG2), logical operation result 3 (LOG3), logical operation result 4 (LOG4), logical operation result 5 (LOG5), logical operation result 6 (LOG6), capacitor life warning (WAC)(*11), cooling-fan speed drop (WAF), starting contact signal (FR), heat sink overheat warning (OHF), low-current indication signal (LOC), general-purpose output 1 (M01), general-purpose output 2 (M02), general-purpose output 3 (M03), general-purpose output 4 (M04), general-purpose output 5 (M05), general-purpose output 6 (M06), inverter ready (IRDY), forward rotation (FWR), reverse rotation (RVR), major failure (MJA), window comparator O (WCO), window comparator OI (WCOI), window comparator O2 (WCO2), alarm code 0 to 3 (AC0 to AC3)			
Monitor output terminals	Analog voltage output, analog current output, pulse-string output (e.g., A-F, D-F [n-fold, pulse output only], A, T, V, P)			
Monitoring on display			Output frequency, output current, output torque, frequency conversion data, trip history, input/output terminal status, electric power, and others	
Other functions			Free V/f setting (7 breakpoints), frequency upper/lower limit, jump (center) frequency, acceleration/deceleration according to characteristic curve, manual torque boost level/breakpoint, energy-saving operation, analog meter adjustment, start frequency setting, carrier frequency adjustment, electronic thermal function (available also for free setting), external start/end frequency/frequency rate, analog input selection, retry after trip, restart after instantaneous power failure, output of various signals, starting with reduced voltage, overload restriction, initial-value setting, automatic deceleration at power failure, AVR function, fuzzy acceleration/deceleration, online/offline auto-tuning, high-torque multi-motor operation(*11) (sensorless vector control of two motors by one inverter)	
Protective functions			Overcurrent protection, overvoltage protection, undervoltage protection, electronic thermal protection, temperature error protection, instantaneous power failure protection, phase loss input protection, braking-resistor overload protection, ground-fault current detection at power-on, USP error, external trip, emergency stop trip, CT error, communication error, option board error, and others	
Environmental conditions	Ambient operating/storage temperature(*7)/ humidity		-10-50°C(*9) / -20-65°C / 20-90%RH (No condensation)	
	Location		Altitude 1,000m or less, indoors (no corrosive gases or dust)	
Options	Digital input expansion card		SJ-DG (4digits BCD, 16bits binary)	
	Feedback expansion card		SJ-FB (vector control loop speed sensor)	
	Network interface card		SJ-DN2(DeviceNet(TM)), SJ-PBT(PROFIBUS)	
Others			EMI filters, input/output reactors, radio noise filters, braking resistors, braking units, LCR filter, communication cables	

\*1: The protection method conforms to JIS C 0920(IEC60529)

\*2: The applicable motor refers to Hitachi standard 3-phase motor (4-pole).

To use other motors, be sure to prevent the rated motor current (50Hz) from exceeding the rated output current of the inverter.

\*3: The output voltage decreases as the main power supply voltage decreases except for the use of AVR function.

\*4: Braking resistor is not integrated in the inverter. Please install optional braking resistor or dynamic braking unit when large braking torque is required.

\*5: Conforms to the test method specified in JIS C 60068-2-6:2010 (IEC 60068-2-6:2007).

\*6: To operate the motor beyond 50/60Hz, please consult with the motor manufacturer about the maximum allowable rotation speed.

\*7: Storage temperature refers to the temperature in transportation.

\*8: The frequency command is the maximum frequency at 9.8V for input voltage 0 to 10VDC, or at 19.8mA for input current 4 to 20mA.If this characteristic is not satisfactory for your application,contact your Hitachi representative.

\*9: SJ700B series is -10 to 45°C.


\*10: Please be sure to connect DC reactor attached to 1850HF,2200HF,3150HF and 4000HF.(1850HF,2200HF and 3150HF of US/JP Version:The DC reactor is not attached.)

\*11: 1850HF,2200HF,3150HF and 4000HF:The function is not provided.




# DIMENSIONS


- SJ700-004~037 LFUF2, LFF2
- SJ700-007~040HFEF2, HFUF2, 007~037HFF2
- SJ700B-055HF

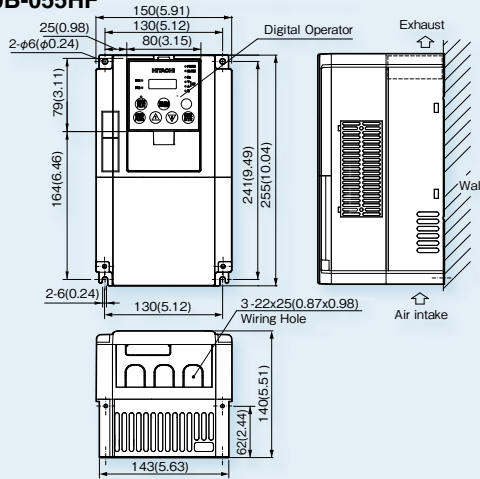


- SJ700-055~110 LFUF2, LFF2 /HFEF2, HFUF2, HFF2
- SJ700B-075~150HFF/HFUF/LFUF

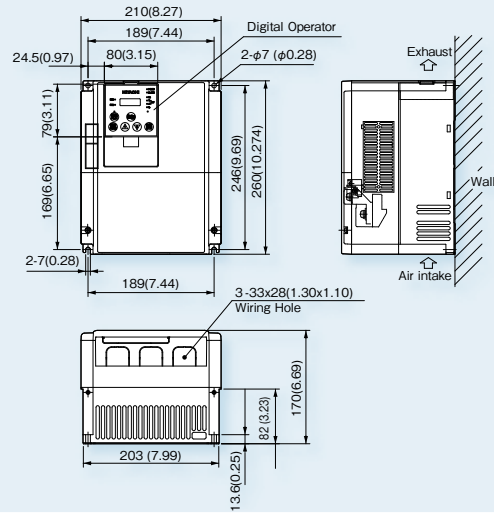


- SJ700-150~220 LFUF2, LFF2 /HFEF2, HFUF2, HFF2
- SJ700B-185~300HFF/HFUF/LFUF

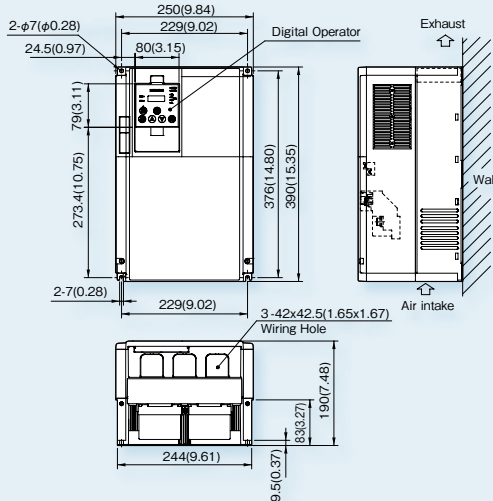


- SJ700-300 LFUF2, LFF2 /HFEF2, HFUF2, HFF2
- SJ700B-370HFF/HFUF/LFUF

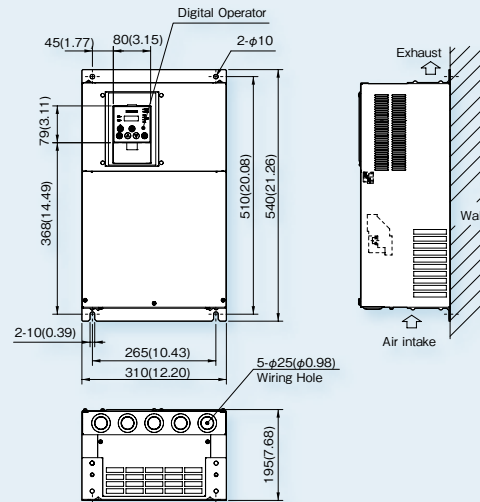

- SJ700-370~450 LFUF2, LFF2
- SJ700-370~550 HFEF2, HFUF2, HFF2
- SJ700B-450~750HFF/HFUF, 450~550LFUF

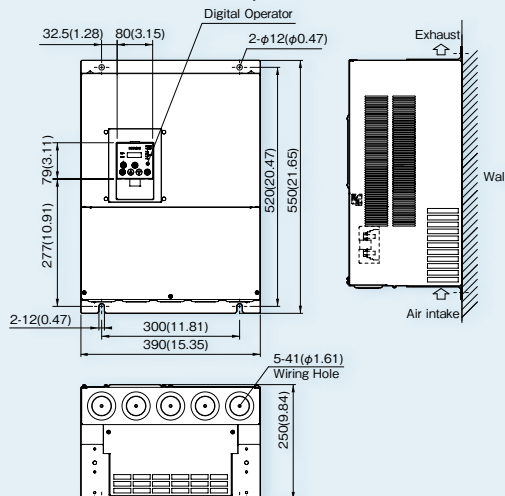


- SJ700-550 LFUF2, LFF2
- SJ700B-750LFUF

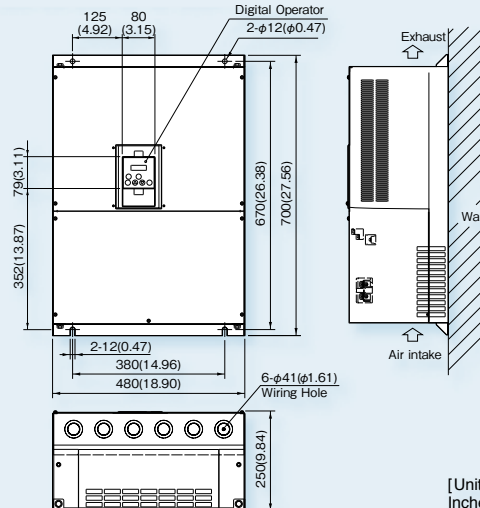


[Unit : mm (inch)]  
Inches for reference only.

# DIMENSIONS

- SJ700-750, 900HFEF2, HFUF2, HFF2
- SJ700B-900, 1100HFF/HFUF

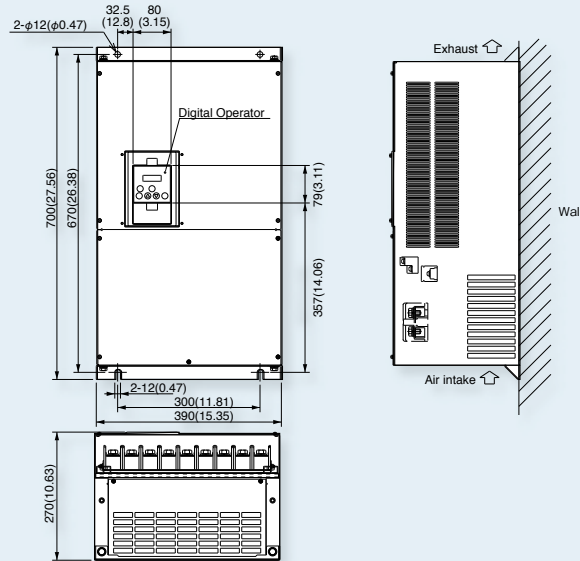


- SJ700-1100HFEF2, HFUF2, HFF2 / 1320HFEF2, HFF2, 1500HFUF2
- SJ700B-1320, 1600HFF, HFUF

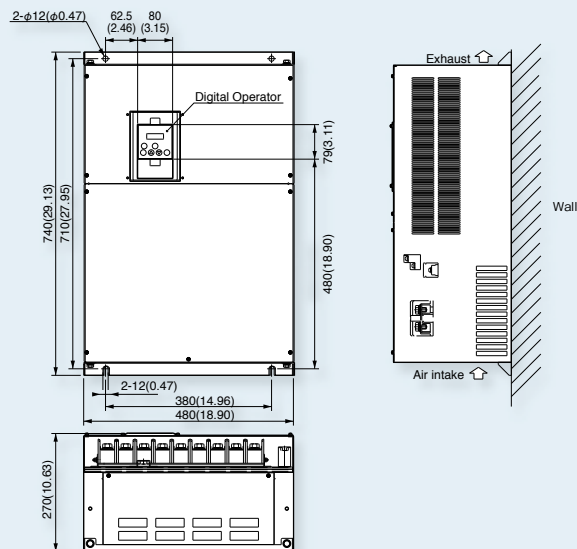


[Unit : mm (inch)]  
Inches for reference only.

# DIMENSIONS


## ● SJ700-1850,2200HFE2/HFU2\*2/HFF2\*2

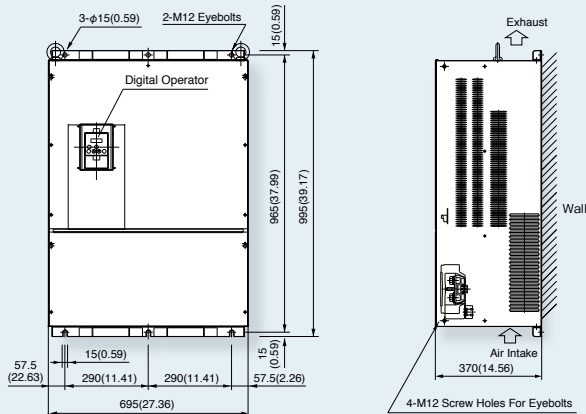


### Attachment DCreactor(DCL-H-185-H-R),(DCL-H-220-H-R)

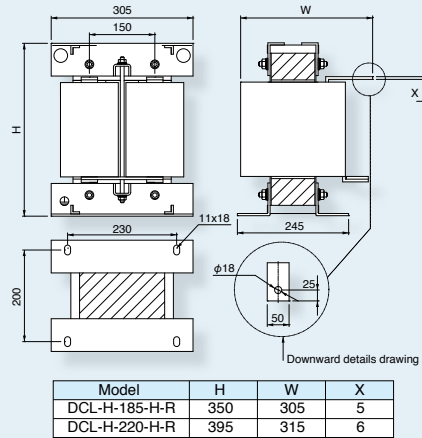

## ● SJ700-3150HFE2/HFU2\*2/HFF2\*2

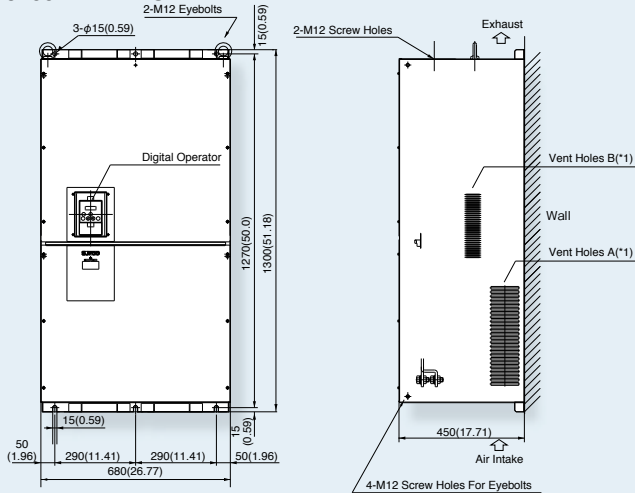


### Attachment DCreactor(DCL-H-315-H-R)

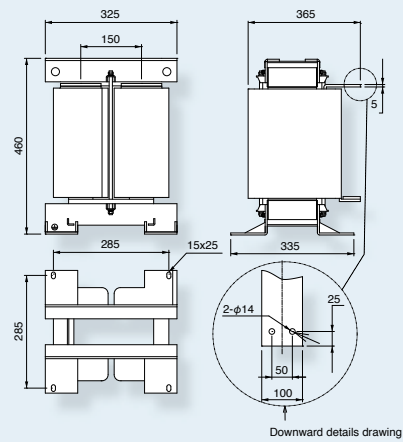


\*1 Vent-Holes A are formed on both right and left side portions. Vent-Holes B are just on right side.

## ● SJ700-4000HFE2/HFU2/HFF2

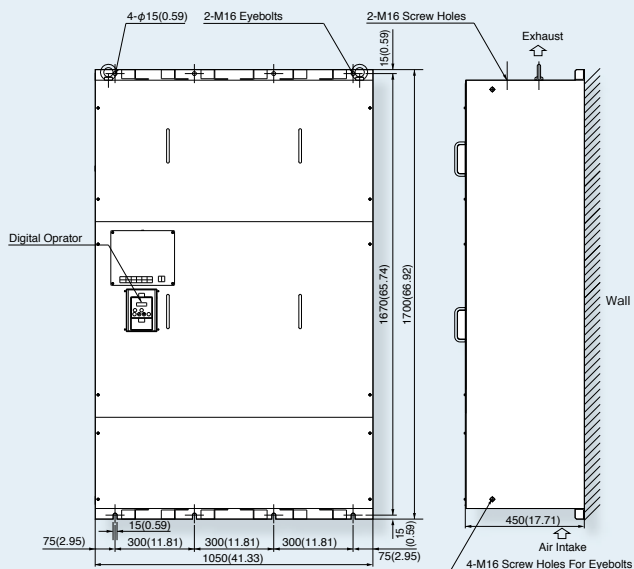

### Attachment DC reactor(DCL-H-400-H-R)

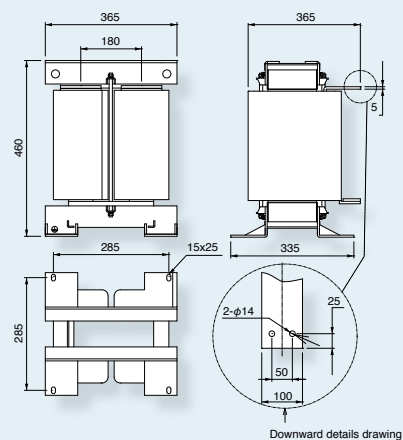

[Unit : mm (inch)]  
Inches for reference only.



# OPERATION and PROGRAMMING

SJ700 and SJ700B Series can be easily operated with the digital operator provided as standard. The digital operator can also be detached and can be used for remote-control. Operator with copy function (WOP) and digital operator with potentiometer are also available as options.

## Parameter Display

Displays frequency, motor current, rotational speed of the motor, and an alarm code.

## Monitor LEDs

Shows drive status.

## RUN key enable LED

Lights up when the inverter is ready to respond to the RUN key.

## RUN Key

Press to run the motor.

## STOP/RESET Key

Press to stop the drive or reset an alarm.

## Function Key

Press to set or monitor a parameter value.

## Power LED

Lights when the power input to the drive is ON.

## ALARM LED

Lights to indicate that the inverter has tripped.

## Display Unit LEDs

Indicates the unit associated with the parameter display.


## Store Key

Press to write the new value to the EEPROM.

## Up/Down Keys

Press up or down to sequence through parameters and functions shown on the display, and increment/decrement values.

## ●Setting the output frequency

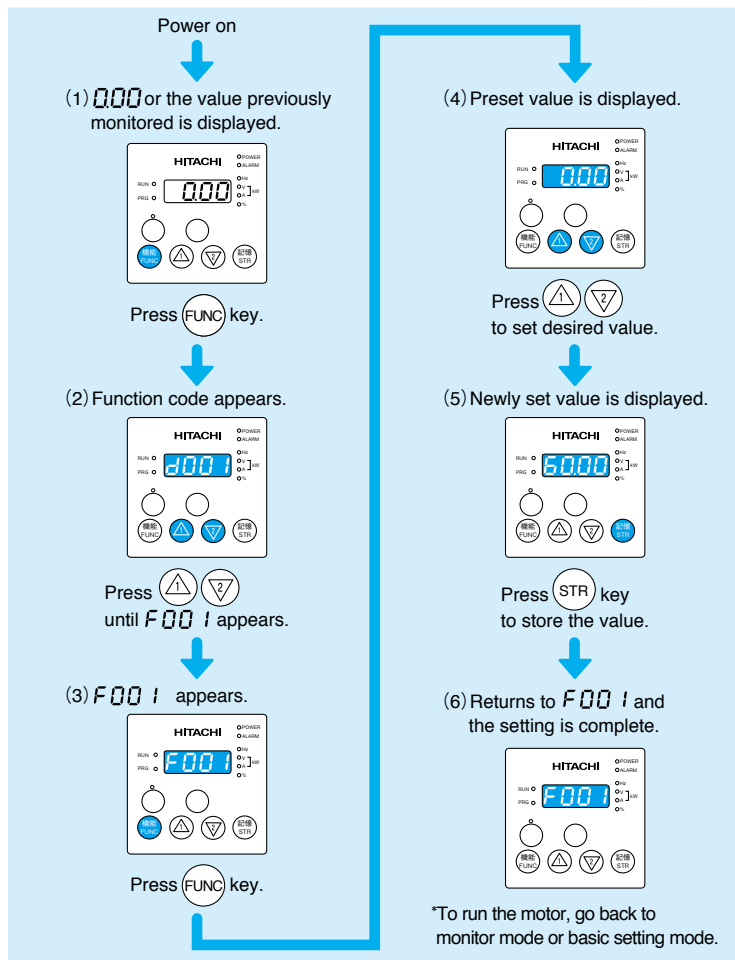

## ●The contents of a basic mode display.(default)

If a desired parameter is not displayed, check the setting of function "b037" (function code display restriction). To display all parameters, specify "00" for "b037".

No.	Display code	Item
1	d001 to d104	Monitor display
2	F001	Output frequency setting
3	F002	Acceleration (1) time setting
4	F003	Deceleration (1) time setting
5	F004	Operation direction setting
6	A001	Frequency source setting
7	A002	Run command source setting
8	A003	Base frequency setting
9	A004	Maximum frequency setting
10	A005	[AT] selection
11	A020	Multi-speed frequency setting
12	A021	Multi-speed 1 setting
13	A022	Multi-speed 2 setting
14	A023	Multi-speed 3 setting
15	A044	1st control method
16	A045	V/f gain setting
17	A085	Operation mode selection
18	b001	Selection of restart mode
19	b002	Allowable under-voltage power failure time
20	b008	Retry-after-trip selection
21	b011	Retry wait time after trip
22	b037	Function code display restriction
23	b083	Carrier frequency setting
24	b084	Initialization mode selection
25	b130	Selection of overvoltage suppression function
26	b131	Setting of overvoltage suppression level
27	C021	Setting of intelligent output terminal 11
28	C022	Setting of intelligent output terminal 12
29	C036	Alarm relay active state

# FUNCTION LIST

## ●MONITORING FUNCTIONS and MAIN PROFILE PARAMETERS

[○= Allowed ×= Not permitted]

Code	Function Name	Monitored data or setting	Default Setting					Setting during operation (allowed or not)	Change during operation (allowed or not)		
			SJ700			SJ700B					
			-FE(CE)	-FU(UL)	-F(JP)	-F(AS)	-FU(UL)				
Monitor Mode	d001	Output frequency monitor	0.00 to 99.99, 100.0 to 400.0 (Hz) (*1)		-	-	-	-	-	○	-
	d002	Output current monitor	0.0 to 999.9, 1000 to 9999 (A)		-	-	-	-	-	-	-
	d003	Rotation direction minitoring	F (forward rotation), o (stopped), r (reverse rotation)		-	-	-	-	-	-	-
	d004	Process variable (PV), PID feedback monitor	0.00 to 99.99, 100.0 to 999.9, 1000. to 9999. 1000 to 9999 (10000 to 99990), 100 to 999 (10000 to 999000)		-	-	-	-	-	-	-
	d005	Intelligent input terminal status	<div><div><div>FW</div><div>ON</div></div><div><div>OFF</div><div>(Example) FW, 7, 2, 1 : ON</div></div><div>8, 6, 5, 4, 3 : OFF</div></div>		-	-	-	-	-	-	-
	d006	Intelligent output terminal status	<div><div><div>ON</div><div>OFF</div></div><div>(Example) 12, 11 : ON</div><div>AL, 15, 14, 13 :OFF</div></div>		-	-	-	-	-	-	-
	d007	Scaled output frequency monitoring	0.00 to 99.99, 100.0 to 999.9, 1000. to 9999., 1000 to 3996 (10000 to 39960)		-	-	-	-	-	○	-
	d008	Actual-frequency monitoring	-400. to -100., -99.9 to 0.00 to 99.99, 100.0 to 400.0 (Hz) (*2)		-	-	-	-	-	-	-
	d009	Torque command monitoring	0. to +200. (%)		-	-	-	-	-	-	-
	d010	Torque bias monitoring	-200. to +200. (%)		-	-	-	-	-	-	-
	d012	Torque monitoring	-200. to +200. (%)		-	-	-	-	-	-	-
	d013	Output voltage monitoring	0.0 to 600.0 (V)		-	-	-	-	-	-	-
	d014	Power monitoring	0.0 to 999.9 (kW)		-	-	-	-	-	-	-
	d015	Cumulative power monitoring	0.0 to 999.9, 1000. to 9999.1000 to 9999 (10000 to 99990), 100 to 999 (100000 to 999000)		-	-	-	-	-	-	-
	d016	Cumulative operation RUN time monitoring	0. to 9999., 1000 to 9999 (10000 to 99990), 100 to 999 (10000 to 999000) (hr)		-	-	-	-	-	-	-
	d017	Cumulative power-on time monitoring	0. to 9999., 1000 to 9999 (10000 to 99990), 100 to 999 (10000 to 999000) (hr)		-	-	-	-	-	-	-
	d018	Heat sink temperature monitoring	-020. to 200.0 (°C)		-	-	-	-	-	-	-
	d019	Motor temperature monitoring	-020. to 200.0 (°C)		-	-	-	-	-	-	-
	d022	Life-check monitoring	<div><div><div>ON</div><div>OFF</div></div><div>1: Capacitor on main circuit board</div><div>2: Cooling-fan speed drop</div></div>		-	-	-	-	-	-	-
	d023	Program counter	0 to 1024		-	-	-	-	-	-	-
	d024	Program number monitoring	0000 to 9999		-	-	-	-	-	-	-
d025	User monitor 0	-2147483647 to 2147483647 (upper 4 digits including "-")		-	-	-	-	-	-	-	
d026	User monitor 1	-2147483647 to 2147483647 (upper 4 digits including "-")		-	-	-	-	-	-	-	
d027	User monitor 2	-2147483647 to 2147483647 (upper 4 digits including "-")		-	-	-	-	-	-	-	
d028	Pulse counter	0 to 2147483647 (upper 4 digits)		-	-	-	-	-	-	-	
d029	Position setting monitor	-1073741823 to 1073741823 (upper 4 digits including "-")		-	-	-	-	-	-	-	
d030	Position feedback monitor	-1073741823 to 1073741823 (upper 4 digits including "-")		-	-	-	-	-	-	-	
d080	Trip Counter	0. to 9999., 1000 to 6553 (10000 to 65530) (times)		-	-	-	-	-	-	-	
d081	Trip monitoring 1-6	Factor, frequency (Hz), current (A), voltage across P-N (V), running time (hours), power-on time (hours)		-	-	-	-	-	-	-	
d086											
d090	Programming error monitoring	Warning code		-	-	-	-	-	-	-	
d102	DC voltage monitoring	0.0 to 999.9 (V)		-	-	-	-	-	-	-	
d103	BRD load factor monitoring	0.0 to 100.0 (%)		-	-	-	-	-	-	-	
d104	Electronic thermal overload monitoring	0.0 to 100.0 (%)		-	-	-	-	-	-	-	
Setting Mode	F001	Output frequency setting	0.0, "start frequency" to "maximum frequency" (or maximum frequency, 2nd/3rd motors) (Hz) 0.0 to 100.0 (when PID function is enabled)	0.00	0.00	0.00	0.00	0.00	○	○	
	F002	Acceleration (1) time setting	0.01 to 99.99, 100.0 to 999.9, 1000. to 3600. (s)	30.00	30.00	30.00	30.00	30.00	○	○	
	F202	Acceleration (1) time setting, 2nd motor	0.01 to 99.99, 100.0 to 999.9, 1000. to 3600. (s)	30.00	30.00	30.00	30.00	30.00	○	○	
	F302	Acceleration (1) time setting, 3rd motor	0.01 to 99.99, 100.0 to 999.9, 1000. to 3600. (s)	30.00	30.00	30.00	30.00	30.00	○	○	
	F003	Deceleration (1) time setting	0.01 to 99.99, 100.0 to 999.9, 1000. to 3600. (s)	30.00	30.00	30.00	30.00	30.00	○	○	
	F203	Deceleration time setting, 2nd motor	0.01 to 99.99, 100.0 to 999.9, 1000. to 3600. (s)	30.00	30.00	30.00	30.00	30.00	○	○	
	F303	Deceleration time setting, 3rd motor	0.01 to 99.99, 100.0 to 999.9, 1000. to 3600. (s)	30.00	30.00	30.00	30.00	30.00	○	○	
	F004	Keypad Run key routing	00 (forward rotation), 01 (reverse rotation)		00	00	00	00	00	×	×
Expanded Function	A---	A Group: Standard functions									
	b---	b Group: Fine tuning functions									
	C---	C Group: Intelligent terminal functions									
	H---	H Group: Motor constants functions									
	P---	P Group: Expansion card functions									
	U---	U Group: User-selectable menu functions									

(\*1) 4000HF:0.00 to 99.99,100.0 to 120.0(Hz) (\*2)4000HF:-120. to -100., -99.9 to 0.00 to 99.99,100.0 to 120.0(Hz)

## ●A GROUP: STANDARD FUNCTIONS

[○= Allowed ×= Not permitted]

Code		Function Name	Monitored data or setting	Default Setting					Setting during operation (allowed or not)	Change during operation (allowed or not)
				SJ700			SJ700B			
				-FE(CE)	-FU(UL)	-F(JP)	-F(AS)	-FU(UL)		
Basic settings	A001	Frequency source setting	00 (keypad potentiometer) (*1), 01 (control circuit terminal block), 02 (digital operator), 03 (RS485), 04 (option 1), 05 (option 2), 06 (pulse-string input), 07 (easy sequence), 10 (operation function result)	01	01	02	01	02	×	×
	A002	Run command source setting	01 (control circuit terminal block), 02 (digital operator), 03 (RS485), 04 (option 1), 05 (option 2)	01	01	02	01	02	×	×
	A003	Base frequency setting	30. to "maximum frequency " (Hz)	50.	60.	60.	50.	60.	×	×
	A203	Base frequency setting, 2nd motor	30. to "maximum frequency, 2nd motor" (Hz)	50.	60.	60.	50.	60.	×	×
	A303	Base frequency setting, 3rd motor	30. to "maximum frequency, 3rd motor" (Hz)	50.	60.	60.	50.	60.	×	×
	A004	Maximum frequency setting	30. to 400. (Hz) (*2)	50.	60.	60.	50.	60.	×	×
	A204	Maximum frequency setting, 2nd motor	30. to 400. (Hz) (*2)	50.	60.	60.	50.	60.	×	×
	A304	Maximum frequency setting, 3rd motor	30. to 400. (Hz) (*2)	50.	60.	60.	50.	60.	×	×
Analog input and others	A005	[AT] selection	00 (switching between O and OI terminals), 01 (switching between O and O2 terminals), 02 (switching between O terminal and keypad potentiometer) (*1), 03 (switching between OI terminal and keypad potentiometer) (*1), 04 (switching between O2 and keypad potentiometer) (*1)	00	00	00	00	00	×	×
	A006	[O2] selection	00 (single), 01 (auxiliary frequency input via O and OI terminals) (nonreversible), 02 (auxiliary frequency input via O and OI terminals) (reversible), 03 (disabling O2 terminal)	03	03	03	03	03	×	×

(\*1) This setting is valid only when the OPE-SR is connected. (\*2) 4000HF:30. to 120. (Hz)

	Code	Function Name	Monitored data or setting	Default Setting					Setting during operation (allowed or not)	Change during operation (allowed or not)
				SJ700			SJ700B			
				-FE(CE)	-FU(UL)	-F(JP)	-F(AS)	-FU(UL)		
Analog input and others	A011	O-L input active range start frequency	0.00 to 99.99, 100.0 to 400.0 (Hz) (*2)	0.00	0.00	0.00	0.00	0.00	×	○
	A012	O-L input active range end frequency	0.00 to 99.99, 100.0 to 400.0 (Hz) (*2)	0.00	0.00	0.00	0.00	0.00	×	○
	A013	O-L input active range start voltabe	0. to "[O]-[L] input active range end voltage" (%)	0.	0.	0.	0.	0.	×	○
	A014	O-L input active range end voltabe	"[O]-[L] input active range start voltage" to 100. (%)	100.	100.	100.	100.	100.	×	○
	A015	O-L input active range start frequency selection	00 (external start frequency), 01 (0 Hz)	01	01	01	01	01	×	○
	A016	External frequency filter time constant	1. to 30. or 31. (500 ms filter ±0.1 Hz with hysteresis)	31.	31.	31.	31.	31.	×	○
	A017	Easy sequence function selection	00 (disabling), 01 (enabling)	00	00	00	00	00	×	×
	A019	Multispeed operation selection	00 (binary: 16 speeds selectable with 4 terminals), 01 (bit: 8 speeds selectable with 7 terminals)	00	00	00	00	00	×	×
	A020	Multispeed frequency setting	0.0 or "start frequency" to "maximum frequency" (Hz)	0.00	0.00	0.00	0.00	0.00	○	○
	A220	Multispeed frequency setting, 2nd motor	0.0 or "start frequency" to "maximum frequency, 2nd motor" (Hz)	0.00	0.00	0.00	0.00	0.00	○	○
A320	Multispeed frequency setting, 3rd motor	0.0 or "start frequency" to "maximum frequency, 3rd motor" (Hz)	0.00	0.00	0.00	0.00	0.00	○	○	
Multispeed operation and Jogging	A021 A035	Multispeed 1-15 setting	0.0 or "start frequency" to "n-th maximum frequency" (Hz)	0.00	0.00	0.00	0.00	0.00	○	○
	A038	Jog frequency setting	"Start frequency" to 9.99 (Hz)	1.00	1.00	1.00	1.00	1.00	○	○
	A039	Jog stop mode	00 (free-running after jogging stops [disabled during operation]), 01 (deceleration and stop after jogging stops [disabled during operation]), 02 (DC braking after jogging stops [disabled during operation]), 03 (free-running after jogging stops [enabled during operation]), 04 (deceleration and stop after jogging stops [enabled during operation]), 05 (DC braking after jogging stops [enabled during operation])	00	00	00	00	00	×	○
	A041	Torque boost method selection	00(Manual torque boost) / 01(Automatic torque boost)	00	00	00	00	00	×	×
	A241	Torque boost method selection, 2nd motor	00(Manual torque boost) / 01(Automatic torque boost)	00	00	00	00	00	×	×
	A042	Manual torque boost value	0.0 to 20.0 (%)	1.0	1.0	1.0	1.0	1.0	○	○
	A242	Manual torque boost value, 2nd motor	0.0 to 20.0 (%)	1.0	1.0	1.0	1.0	1.0	○	○
	A342	Manual torque boost value, 3rd motor	0.0 to 20.0 (%)	1.0	1.0	1.0	1.0	1.0	○	○
	A043	Manual torque boost frequency adjustment	0.0 to 50.0 (%)	5.0	5.0	5.0	5.0	5.0	○	○
	A243	Manual torque boost frequency adjustment, 2nd motor	0.0 to 50.0 (%)	5.0	5.0	5.0	5.0	5.0	○	○
V/f Characteristic	A343	Manual torque boost frequency adjustment, 3rd motor	0.0 to 50.0 (%)	5.0	5.0	5.0	5.0	5.0	○	○
	A044	V/F characteristic curve selection, 1st motor	00 (VC), 01 (VP), 02 (free V/f), 03 (sensorless vector control), 04(*1) (0Hz-range sensorless vector), 05(*1) (vector with sensor)	00	00	00	00	00	×	×
	A244	V/F characteristic curve selection, 2nd motor	00 (VC), 01 (VP), 02 (free V/f), 03 (sensorless vector control), 04 (0Hz-range sensorless vector)	00	00	00	00	00	×	×
	A344	V/F characteristic curve selection, 3rd motor	00(VC), 01(VP)	00	00	00	00	00	×	×
	A045	V/f gain setting	20. to 100. (%)	100.	100.	100.	100.	100.	○	○
	A046	Voltage compensation gain setting for automatic torque boost, 1st motor	0. to 255.	100.	100.	100.	100.	100.	○	○
	A246	Voltage compensation gain setting for automatic torque boost, 2nd motor	0. to 255.	100.	100.	100.	100.	100.	○	○
	A047	Slippage compensation gain setting for automatic torque boost, 1st motor	0. to 255.	100.	100.	100.	100.	100.	○	○
	A247	Slippage compensation gain setting for automatic torque boost, 2nd motor	0. to 255.	100.	100.	100.	100.	100.	○	○
	DC Braking	A051	DC braking enable	00 (disabling), 01 (enabling), 02 (set frequency only)	00	00	00	00	00	×
A052		DC braking frequency setting	0.00 to 99.99, 100.0 to 400.0 (Hz)(*2)	0.50	0.50	0.50	0.50	0.50	×	○
A053		DC braking wait time	0.0 to 5.0 (s)	0.0	0.0	0.0	0.0	0.0	×	○
A054		DC braking force during deceleration	SJ700: 0. to 100. (%) <75 to 132kW:0. to 80./185kW and over:0. to 35.> SJ700B: 0. to 70. (%) <90kW and over:0. to 50.>	0	0	0	0	20.0	×	○
A055		DC braking time for deceleration	0.0 to 60.0 (s)	0.0	0.0	0.0	0.0	0.5	×	○
A056		DC braking/edge or level detection for [DB] input	00 (edge operation), 01 (level operation)	01	01	01	01	01	×	○
A057		DC braking force for starting	SJ700: 0. to 100. (%) <75 to 132kW:0. to 80./185kW and over:0. to 35.> SJ700B: 0. to 70. (%) <90kW and over:0. to 50.>	0.	0.	0.	0.	0.	×	○
A058		DC braking time for starting	0.0 to 60.0(s)	0.0	0.0	0.0	0.0	0.0	×	○
A059		DC braking carrier frequency setting	SJ700: 0.5 to 15.0(kHz) <75 to 132kW:0.5 to 10.0/185kW and over:0.5 to 3.0> SJ700B: 0.5 to 12.0 (kHz) <90kW and over:0.5 to 8.0>	5.0	5.0	5.0	3.0	3.0	×	×
Frequency Upper/Lower Limit and Jump Frequency		A061	Frequency upper limit setting	0.00 or "1st minimum frequency limit" to "maximum frequency" (Hz)	0.00	0.00	0.00	0.00	0.00	×
	A261	Frequency upper limit setting, 2nd motor	0.00 or "2nd minimum frequency limit" to "maximum frequency, 2nd motor" (Hz)	0.00	0.00	0.00	0.00	0.00	×	○
	A062	Frequency lower limit setting	0.00 or "start frequency" to "maximum frequency limit" (Hz)	0.00	0.00	0.00	0.00	0.00	×	○
	A262	Frequency lower limit setting, 2nd motor	0.00 or "start frequency" to "maximum frequency, 2nd motor limit" (Hz)	0.00	0.00	0.00	0.00	0.00	×	○
	A063	Jump (center) frequency setting 1	0.00 to 99.99, 100.0 to 400.0 (Hz)(*2)	0.00	0.00	0.00	0.00	0.00	×	○
	A064	Jump (hysteresis) frequency width setting 1	0.00 to 10.00 (Hz)	0.50	0.50	0.50	0.50	0.50	×	○
	A065	Jump (center) frequency setting 2	0.00 to 99.99, 100.0 to 400.0 (Hz)(*2)	0.00	0.00	0.00	0.00	0.00	×	○
	A066	Jump (hysteresis) frequency width setting 2	0.00 to 10.00 (Hz)	0.50	0.50	0.50	0.50	0.50	×	○
	A067	Jump (center) frequency setting 3	0.00 to 99.99, 100.0 to 400.0 (Hz)(*2)	0.00	0.00	0.00	0.00	0.00	×	○
	A068	Jump (hysteresis) frequency width setting 3	0.00 to 10.00 (Hz)	0.50	0.50	0.50	0.50	0.50	×	○
PID Control	A069	Acceleration stop time frequency setting	0.00 to 99.99, 100.0 to 400.0 (Hz)(*2)	0.00	0.00	0.00	0.00	0.00	×	○
	A070	Acceleration stop time frequency setting	0.0 to 60.0 (s)	0.0	0.0	0.0	0.0	0.0	×	○
	A071	PID function enable	00 (disabling), 01 (enabling), 02 (enabling inverted-data output)	00	00	00	00	00	×	○
	A072	PID proportional gain	0.2 to 5.0	1.0	1.0	1.0	1.0	1.0	○	○
	A073	PID integral time constant	0.0 to 999.9, 1000. to 3600.0 (s)	1.0	1.0	1.0	1.0	1.0	○	○
	A074	PID derivative gain	0.00 to 99.99, 100.0 (s)	0.00	0.00	0.00	0.00	0.00	○	○
	A075	PV scale conversion	0.01 to 99.99	1.00	1.00	1.00	1.00	1.00	×	○
	A076	PV source setting	00 (input via OI), 01 (input via O), 02 (external communication), 03 (pulse-string frequency input), 10 (operation result output)	00	00	00	00	00	×	○
	A077	Output of inverted PID deviation	00(OFF), 01 (ON)	00	00	00	00	00	×	○
	A078	PID variation range	0.0 to 100.0 (%)	0.0	0.0	0.0	0.0	0.0	×	○
AVR	A081	AVR function select	00 (always on), 01 (always off), 02 (off during deceleration)	00	00	00	00	02	×	×
	A082	AVR voltage select	200 V class: 200, 215, 220, 230, 240 (V) 400 V class: 380, 400, 415, 440, 460, 480 (V)	230/460	230/400	200/400	200/400	200/400	×	×
	A085	Operation mode selection	00(Normal operation)/ 01(Energy-saving operation)/ 02(Fuzzy operation)	00	00	00	00	00	×	×
	A086	Energy saving mode tuning	0.1 to 100.0	50.0	50.0	50.0	50.0	50.0	○	○
	A092	Acceleration (2) time setting	0.01 to 99.99, 100.0 to 999.9, 1000. to 3600. (s)	15.00	15.00	15.00	15.00	15.00	○	○
	A292	Acceleration (2) time setting, 2nd motor	0.01 to 99.99, 100.0 to 999.9, 1000. to 3600. (s)	15.00	15.00	15.00	15.00	15.00	○	○
	A392	Acceleration (2) time setting, 3rd motor	0.01 to 99.99, 100.0 to 999.9, 1000. to 3600. (s)	15.00	15.00	15.00	15.00	15.00	○	○
	A093	Deceleration (2) time setting	0.01 to 99.99, 100.0 to 999.9, 1000. to 3600. (s)	15.00	15.00	15.00	15.00	15.00	○	○
	A293	Deceleration (2) time setting, 2nd motor	0.01 to 99.99, 100.0 to 999.9, 1000. to 3600. (s)	15.00	15.00	15.00	15.00	15.00	○	○
	A393	Deceleration (2) time setting, 3rd motor	0.01 to 99.99, 100.0 to 999.9, 1000. to 3600. (s)	15.00	15.00	15.00	15.00	15.00	○	○

(\*1) Derating is applied for SJ700B. Please consult technician at Hitachi or its distributor before use. (\*2) 4000HF:0.00 to 99.99,100.0 to 120.0(Hz)



【○= Allowed ×= Not permitted】

Code			Function Name	Monitored data or setting	Default Setting					Setting during operation (allowed or not)	Change during operation (allowed or not)
					SJ700			SJ700B			
					-FE(CE)	-FU(UL)	-F(JP)	-F(AS)	-FU(UL)		
External frequency adjustment	A094	Select method to switch to Acc2/Dec2 profile	00 (switching by 2CH terminal), 01 (switching by setting), 02 (switching only when rotation is reversed)	00	00	00	00	00	×	×	
	A294	Select method to switch to Acc2/Dec2, 2nd motor	00 (switching by 2CH terminal), 01 (switching by setting), 02 (switching only when rotation is reversed)	00	00	00	00	00	×	×	
	A095	Acc1 to Acc2 frequency transition point	0.00 to 99.99, 100.0 to 400.0 (Hz) (*1)	0.00	0.00	0.00	0.00	0.00	×	×	
	A295	Acc1 to Acc2 frequency transition point, 2nd motor	0.00 to 99.99, 100.0 to 400.0 (Hz) (*1)	0.00	0.00	0.00	0.00	0.00	×	×	
	A096	Dec1 to Dec2 frequency transition point	0.00 to 99.99, 100.0 to 400.0 (Hz) (*1)	0.00	0.00	0.00	0.00	0.00	×	×	
	A296	Dec1 to Dec2 frequency transition point, 2nd motor	0.00 to 99.99, 100.0 to 400.0 (Hz) (*1)	0.00	0.00	0.00	0.00	0.00	×	×	
	A097	Acceleration curve selection	00 (linear), 01 (S curve), 02 (U curve), 03 (inverted-U curve), 04 (EL-S curve)	00	00	00	00	00	×	×	
	A098	Deceleration curve selection	00 (linear), 01 (S curve), 02 (U curve), 03 (inverted-U curve), 04 (EL-S curve)	00	00	00	00	00	×	×	
	A101	OL-L input active range start frequency	0.00 to 99.99, 100.0 to 400.0 (Hz) (*1)	0.00	0.00	0.00	0.00	0.00	×	×	
	A102	OL-L input active range end frequency	0.00 to 99.99, 100.0 to 400.0 (Hz) (*1)	0.00	0.00	0.00	0.00	0.00	×	○	
	A103	OL-L input active range start current	0. to "[OI]-[L] input active range end current" (%)	20.	20.	20.	20.	20.	×	○	
	A104	OL-L input active range end current	"[OI]-[L] input active range start current" to 100. (%)	100.	100.	100.	100.	100.	×	○	
	A105	OL-L input start frequency enable	00 (external start frequency), 1 (0 Hz)	00	00	00	00	00	×	○	
	A111	O2-L input active range start frequency	-400. to -100., -99.9 to 0.00 to 99.99, 100.0 to 400.0 (Hz) (*2)	0.00	0.00	0.00	0.00	0.00	×	○	
A112	O2-L input active range end frequency	-400. to -100., -99.9 to 0.00 to 99.99, 100.0 to 400.0 (Hz) (*2)	0.00	0.00	0.00	0.00	0.00	×	○		
A113	O2-L input active range start voltage	-100. to O2 end-frequency rate (%)	-100.	-100.	-100.	-100.	-100.	×	○		
A114	O2-L input active range end voltage	"O2 start-frequency rate" to 100. (%)	100.	100.	100.	100.	100.	×	○		
Acceleration and deceleration	A131	Acceleration curve constants setting	01 (smallest swelling) to 10 (largest swelling)	02	02	02	02	02	×	○	
	A132	Deceleration curve constants setting	01 (smallest swelling) to 10 (largest swelling)	02	02	02	02	02	×	○	
Operation-target frequency	A141	Operation-target frequency selection 1	00 (digital operator), 01 (keypad potentiometer), 02 (input via O), 03 (input via OI), 04 (external communication), 05 (option 1), 06 (option 2), 07 (pulse-string frequency input)	02	02	02	02	02	×	○	
	A142	Operation-target frequency selection 2	00 (digital operator), 01 (keypad potentiometer), 02 (input via O), 03 (input via OI), 04 (external communication), 05 (option 1), 06 (option 2), 07 (pulse-string frequency input)	03	03	03	03	03	×	○	
	A143	Operator selection	00 (addition: A141 + A142), 01 (subtraction: A141 - A142), 02 (multiplication: A141 x A142)	00	00	00	00	00	×	○	
	A145	Frequency to be added	0.00 to 99.99, 100.0 to 400.0 (Hz) (*1)	0.00	0.00	0.00	0.00	0.00	×	○	
	A146	Sign of the frequency to be added	00 (frequency command + A145), 01 (frequency command - A145)	00	00	00	00	00	×	○	
Acceleration and deceleration	A150	EL-S-curve acceleration ratio 1	0. to 50. (%)	25.	25.	25.	25.	25.	×	×	
	A151	EL-S-curve acceleration ratio 2	0. to 50. (%)	25.	25.	25.	25.	25.	×	×	
	A152	EL-S-curve deceleration ratio 1	0. to 50. (%)	25.	25.	25.	25.	25.	×	×	
	A153	EL-S-curve deceleration ratio 2	0. to 50. (%)	25.	25.	25.	25.	25.	×	×	

(\*1) 4000HF:0.00 to 99.99, 100.0 to 120.0(Hz) (\*2) -120. to -100., -99.9 to 0.00 to 99.99, 100.0 to 120.0(Hz)

## ●B GROUP: FINE TUNING FUNCTIONS

【○= Allowed ×= Not permitted】

Code		Function Name	Monitored data or setting	Default Setting					Setting during operation (allowed or not)	Change during operation (allowed or not)
				SJ700			SJ700B			
				-FE(CE)	-FU(UL)	-F(JP)	-F(AS)	-FU(UL)		
Restart after instantaneous power failure or tripping	b001	Selection of restart mode	00 (tripping), 01 (starting with 0 Hz), 02 (starting with matching frequency), 03 (tripping after deceleration and stopping with matching frequency), 04 (restarting with active matching frequency)	00	00	00	00	00	×	○
	b002	Allowable under-voltage power failure time	0.3 to 25.0 (s)	1.0	1.0	1.0	1.0	1.0	×	○
	b003	Retry wait time before motor restart	0.3 to 100.0 (s)	1.0(*1)	1.0(*1)	1.0(*1)	1.0	1.0	×	○
	b004	Instantaneous power failure/under-voltage trip alarm enable	00 (disabling), 01 (enabling), 02 (disabling during stopping and decelerating to stop)	00	00	00	00	00	×	○
	b005	Number of restarts on power failure/under-voltage trip events	00 (16 times), 01 (unlimited)	00	00	00	00	00	×	○
	b006	Phase loss detection enable	00 (disabling), 01 (enabling)	00	00	00	00	00	×	○
	b007	Restart frequency threshold	0.00 to 99.99, 100.0 to 400.0 (Hz) (*2)	0.00	0.00	0.00	0.00	0.00	×	○
	b008	Selection of retry after tripping	00 (tripping), 01 (starting with 0 Hz), 02 (starting with matching frequency), 03 (tripping after deceleration and stopping with matching frequency), 04 (restarting with active matching frequency)	00	00	00	00	00	×	○
	b009	Selection of retry after undervoltage	00 (16 times), 01 (unlimited)	00	00	00	00	00	×	○
	b010	Selection of retry count after overvoltage or overcurrent	1 to 3 (times)	3	3	3	3	3	×	○
	b011	Retry wait time after tripping	0.3 to 100.0 (s)	1.0(*1)	1.0(*1)	1.0(*1)	1.0	1.0	×	○
Electronic thermal function	b012	Electronic thermal setting (calculated within the inverter from current output)	0.20 x "rated current" to 1.00 x "rated current" (A)	Rated current of inverter x 1.00					×	○
	b212	Electronic thermal setting (calculated within the inverter from current output), 2nd motor	0.20 x "rated current" to 1.00 x "rated current" (A)						×	○
	b312	Electronic thermal setting (calculated within the inverter from current output), 3rd motor	0.20 x "rated current" to 1.00 x "rated current" (A)						×	○
	b013	Electronic thermal characteristic	00 (reduced-torque characteristic), 01 (constant-torque characteristic), 02 (free setting)	01	01	00	01	01	×	○
	b213	Electronic thermal characteristic, 2nd motor	00 (reduced-torque characteristic), 01 (constant-torque characteristic), 02 (free setting)	01	01	00	01	01	×	○
	b313	Electronic thermal characteristic, 3rd motor	00 (reduced-torque characteristic), 01 (constant-torque characteristic), 02 (free setting)	01	01	00	01	01	×	○
	b015	Free-setting electronic thermal frequency (1)	0. to 400. (Hz)(*3)	0.	0.	0.	0.	0.	×	○
	b016	Free-setting electronic thermal current (1)	0.00 to rated current (A)	0.0	0.0	0.0	0.0	0.0	×	○
	b017	Free-setting electronic thermal frequency (2)	0. to 400. (Hz)(*3)	0.	0.	0.	0.	0.	×	○
	b018	Free-setting electronic thermal current (2)	0.00 to rated current (A)	0.0	0.0	0.0	0.0	0.0	×	○
	b019	Free-setting electronic thermal frequency (3)	0. to 400. (Hz)(*3)	0.	0.	0.	0.	0.	×	○
b020	Free-setting electronic thermal current (3)	0.00 to rated current (A)	0.0	0.0	0.0	0.0	0.0	×	○	
Overload restriction and overcurrent restraint	b021	Overload restriction operation mode	00 (disabling), 01 (enabling during acceleration and deceleration), 02 (enabling during constant speed), 03 (enabling during acceleration and deceleration (increasing the speed during regeneration))	01	01	01	01	01	×	○
	b022	Overload restriction setting	SJ700: 0.20 x "rated current" to 2.00 x "rated current" (A) < 75kW and over: 0.20 x 1.80 > SJ700B: 0.20 x "rated current" to 1.50 x "rated current" (A)	Rated current x 1.50			Rated current x 1.20		×	○
	b023	Deceleration rate at overload restriction	0.10 to 30.00 (s)	1.00	1.00	1.00	1.00	1.00	×	○
	b024	Overload restriction operation mode (2)	00 (disabling), 01 (enabling during acceleration and deceleration), 02 (enabling during constant speed), 03 (enabling during acceleration and deceleration (increasing the speed during regeneration))	01	01	01	01	01	×	○
	b025	Overload restriction setting (2)	SJ700: 0.20 x "rated current" to 2.00 x "rated current" (A) < 75kW and over: 0.20 x 1.80 > SJ700B: 0.20 x "rated current" to 1.50 x "rated current" (A)	Rated current x 1.50			Rated current x 1.20		×	○
	b026	Deceleration rate at overload restriction (2)	0.10 to 30.00 (s)	1.00	1.00	1.00	1.00	1.00	×	○
	b027	Overcurrent suppression enable	00 (disabling), 01 (enabling)	01	01	01	01	01	×	○

(\*1) 4000HF:5.0 (\*2) 4000HF:0.00 to 99.99,100.0 to 120.0 (Hz) (\*3) 4000HF:0. to 120.(Hz)

Code		Function Name	Monitored data or setting	Default Setting					Setting during operation (allowed or not)	Change during operation (allowed or not)				
				SJ700			SJ700B							
				-FE(CE)	-FU(UL)	-FJP	-F(AS)	-FU(UL)						
Overload restriction and overcurrent restraint	b028	Active frequency matching, scan start frequency	SJ700: 0.20 x "rated current" to 2.00 x "rated current" (A) < 75kW and over:0.20 x 1.50 > SJ700B: 0.20 x "rated current" to 1.50 x "rated current" (A)					Rated current of inverter x 1.00		×	○			
	b029	Active frequency matching, scan-time constant	0.10 to 30.00 (s)					0.50	0.50	0.50	0.50	0.50	×	○
	b030	Active frequency matching, restart frequency select	00 (frequency at the last shutoff), 01 (maximum frequency), 02 (set frequency)					00	00	00	00	00	×	○
software lock	b031	Software lock mode selection	00 (disabling change of data other than "b031" when SFT is on), 01 (disabling change of data other than "b031" and frequency settings when SFT is on), 02 (disabling change of data other than "b031"), 03 (disabling change of data other than "b031" and frequency settings), 10 (enabling data changes during operation)					01	01	01	01	01	×	○
	b034	RUN/ power-on warning time	0. to 9999. (0 to 99990), 1000 to 6553 (10000 to 655300) (hr)					0.	0.	0.	0.	0.	×	○
	b035	Rotational direction restriction	00 (enabling both forward and reverse rotations), 01 (enabling only forward rotation), 02 (enabling only reverse rotation)					00	00	00	00	00	×	×
Others	b036	Reduced voltage start selection	0 (minimum reduced voltage start time) to 255 (maximum reduced voltage start time)					06	06	06	06	06	×	○
	b037	Function code display restriction	00 (full display), 01 (function-specific display), 02 (user setting), 03 (data comparison display), 04 (basic display)					04	04	04	04	04	×	○
	b038	Initial-screen selection	00 (screen displayed when the STR key was pressed last), 01 (d001), 02 (d002), 03 (d003), 04 (d007), 05 (F001)					01	01	01	01	01	×	○
Torque limitation	b039	Automatic user-parameter setting function enable	00 (disabling), 01 (enabling)					00	00	00	00	00	×	○
	b040	Torque limit selection	00 (quadrant-specific setting), 01 (switching by terminal), 02 (analog input), 03 (option 1), 04 (option 2)					00	00	00	00	00	×	○
	b041	Torque limit(1) (Forward-driving in 4-quadrant mode)	SJ700: 0. to 200. (%), no (disabling torque limitation) < 75kW and over:0. to 180.> SJ700B: 0. to 150.(%), no (disabling torque limitation)					150.	150.	150.	150.	120.	×	○
Non-stop operation at momentary power failure	b042	Torque limit(2) (Reverse-regenerating in 4-quadrant mode)	SJ700: 0. to 200. (%), no (disabling torque limitation) < 75kW and over:0. to 180.> SJ700B: 0. to 150.(%), no (disabling torque limitation)					150.	150.	150.	150.	120.	×	○
	b043	Torque limit(3) (Reverse-driving in 4-quadrant mode)	SJ700: 0. to 200. (%), no (disabling torque limitation) < 75kW and over:0. to 180.> SJ700B: 0. to 150.(%), no (disabling torque limitation)					150.	150.	150.	150.	120.	×	○
	b044	Torque limit(4) (Forward-regenerating in 4-quadrant mode)	SJ700: 0. to 200. (%), no (disabling torque limitation) < 75kW and over:0. to 180.> SJ700B: 0. to 150.(%), no (disabling torque limitation)					150.	150.	150.	150.	120.	×	○
Window comparator	b045	Torque limit LADSTOP enable	00 (disabling), 01 (enabling)					00	00	00	00	00	×	○
	b046	Reverse RUN protection enable	00 (disabling), 01 (enabling)					00	00	00	00	01	×	○
	b050	Controlled deceleration and stop on power loss	00 (disabling), 01 (enabling)					00	00	00	00	00	×	×
Others	b051	DC bus voltage trigger level during power loss	0.0 to 999.9, 1000. (V)					220.0/440.0	220.0/440.0	220.0/440.0	220.0/440.0	220.0/440.0	×	×
	b052	Over-voltage threshold during power loss	0.0 to 999.9, 1000. (V)					360.0/720.0	360.0/720.0	360.0/720.0	360.0/720.0	360.0/720.0	×	×
	b053	Deceleration time setting during power loss	0.01 to 99.99, 100.0 to 999.9, 1000. to 3600. (s)					1.00	1.00	1.00	1.00	1.00	×	×
Window comparator	b054	Initial output frequency decrease during power loss	0.00 to 10.00 (Hz)					0.00	0.00	0.00	0.00	0.00	×	×
	b055	Proportional gain setting for nonstop operation at power loss	0.00 to 2.55					0.20	0.20	0.20	0.20	0.20	○	○
	b056	Integral time setting for nonstop operation at power loss	0.0 to 9.999 /10.00 to 65.55					0.100	0.100	0.100	0.100	0.100	○	○
Others	b060	Maximum-limit level of window comparators O	0. to 100. (lower limit : b061 + b062*2) (%)					100	100	100	100	100	○	○
	b061	Minimum-limit level of window comparators O	0. to 100. (lower limit : b060 - b062*2) (%)					0	0	0	0	0	○	○
	b062	Hysteresis width of window comparators O	0. to 10. (lower limit : b061 - b062 / 2) (%)					0	0	0	0	0	○	○
Window comparator	b063	Maximum-limit level of window comparators OI	0. to 100. (lower limit : b064 + b066*2) (%)					100	100	100	100	100	○	○
	b064	Minimum-limit level of window comparators OI	0. to 100. (lower limit : b063 - b066*2) (%)					0	0	0	0	0	○	○
	b065	Hysteresis width of window comparators OI	0. to 10. (lower limit : b063 - b064 / 2) (%)					0	0	0	0	0	○	○
Others	b066	Maximum-limit level of window comparators OI	-100. to 100. (lower limit : b067 + b068*2) (%)					100	100	100	100	100	○	○
	b067	Minimum-limit level of window comparators O/OI/O2	-100. to 100. (lower limit : b066 - b068*2) (%)					-100	-100	-100	-100	-100	○	○
	b068	Hysteresis width of window comparators O/OI/O2	0. to 10. (lower limit : b066 - b067 / 2) (%)					0	0	0	0	0	○	○
Window comparator	b070	Operation level at O disconnection	0 to 100 (%) or "no" (ignore)					255(no)	255(no)	255(no)	255(no)	255(no)	×	○
	b071	Operation level at OI disconnection	0 to 100 (%) or "no" (ignore)					255(no)	255(no)	255(no)	255(no)	255(no)	×	○
	b072	Operation level at O2 disconnection	0 to 100 (%) or "no" (ignore)					127(no)	127(no)	127(no)	127(no)	127(no)	×	○
Others	b078	Cumulative input power data clearance	Clearance by setting "01" and pressing the STR key					00	00	00	00	00	○	○
	b079	Cumulative input power display gain setting	1. to 1000.					1.	1.	1.	1.	1.	×	×
	b082	Start frequency adjustment	0.10 to 9.99 (Hz)					0.50	0.50	0.50	0.50	0.50	×	○
Window comparator	b083	Carrier frequency setting	SJ700: 0.5 to 15.0(kHz) <75 to 132kW:0.5 to 10.0/185kW and over:0.5 to 3.0> SJ700B: 0.5 to 12.0 (kHz) <90kW and over:0.5 to 8.0.>					5.0(*2)	5.0(*2)	5.0(*2)	3.0(*1)	3.0(*1)	×	×
	b084	Initialization mode (parameters or trip history)	00 (clearing the trip history), 01 (initializing the data), 02 (clearing the trip history and initializing the data)					00	00	00	00	00	×	×
	b085	Country code for initialization	00 (Japan), 01 (EU), 02 (U.S.A.)					01	02	00	01	02	×	×
Others	b086	Frequency scaling conversion factor	0.1 to 99.0					1.0	1.0	1.0	1.0	1.0	○	○
	b087	STOP key enable	00 (enabling), 01 (disabling), 02 (disabling only the function to stop)					00	00	00	00	00	×	○
	b088	Restart mode after FRS	00 (starting with 0 Hz), 01 (starting with matching frequency), 02 (starting with active matching frequency)					00	00	00	00	00	×	○
Window comparator	b089	Automatic carrier frequency reduction	00: invalid, 01: valid					00	00	00	00	00	×	×
	b090	Dynamic braking usage ratio	0.0 to 100.0 (%)					0.0	0.0	0.0	0.0	0.0	×	○
	b091	Stop mode selection	00 (deceleration until stop), 01 (free-run stop)					00	00	00	00	00	×	○
Others	b092	Cooling fan control	00 (always operating the fan), 01 (operating the fan only during inverter operation [including 5 minutes after power-on and power-off])					00	00	00	00	01	×	○
	b095	Dynamic braking control	00 (disabling), 01 (enabling [disabling while the motor is topped]), 02 (enabling [enabling also while the motor is topped])					00	00	00	00	01	×	○
	b096	Dynamic braking activation level	330 to 380, 660 to 760(V)					360/720	360/720	360/720	360/720	360/720	×	○
Window comparator	b098	Thermistor for thermal protection control	00 (disabling the thermistor), 01 (enabling the thermistor with PTC), 02 (enabling the thermistor with NTC)					00	00	00	00	00	×	○
	b099	Thermal protection level setting	0. to 9999. (℃)					3000.	3000.	3000.	3000.	3000.	×	○
	b100	Free-setting V/f frequency (1)	0. to "free-setting V/f frequency (2)" (Hz)					0.	0.	0.	0.	0.	×	×
Free setting of V/f characteristic	b101	Free-setting V/f voltage (1)	0.0 to 800.0 (V)					0.0	0.0	0.0	0.0	0.0	×	×
	b102	Free-setting V/f frequency (2)	0. to "free-setting V/f frequency (3)" (Hz)					0.	0.	0.	0.	0.	×	×
	b103	Free-setting V/f voltage (2)	0.0 to 800.0 (V)					0.0	0.0	0.0	0.0	0.0	×	×
Window comparator	b104	Free-setting V/f frequency (3)	0. to "free-setting V/f frequency (4)" (Hz)					0.	0.	0.	0.	0.	×	×
	b105	Free-setting V/f voltage (3)	0.0 to 800.0 (V)					0.0	0.0	0.0	0.0	0.0	×	×
	b106	Free-setting V/f frequency (4)	0. to "free-setting V/f frequency (5)" (Hz)					0.	0.	0.	0.	0.	×	×
Others	b107	Free-setting V/f voltage (4)	0.0 to 800.0 (V)					0.0	0.0	0.0	0.0	0.0	×	×
	b108	Free-setting V/f frequency (5)	0. to "free-setting V/f frequency (6)" (Hz)					0.	0.	0.	0.	0.	×	×
	b109	Free-setting V/f voltage (5)	0.0 to 800.0 (V)					0.0	0.0	0.0	0.0	0.0	×	×
Window comparator	b110	Free-setting V/f frequency (6)	0. to "free-setting V/f frequency (7)" (Hz)					0.	0.	0.	0.	0.	×	×
	b111	Free-setting V/f voltage (6)	0.0 to 800.0 (V)					0.0	0.0	0.0	0.0	0.0	×	×

(\*1) "Over current protection", "Overload restriction", "Over current limiting" and "Electronic thermal protection" might operate from the set value when "Carrier frequency setting" is used with less than 2kHz by a low value. Please set to 2kHz or more and use the setting of "Carrier frequency setting" for such a situation. (\*2) 1850HF, 2200HF and 3150HF:2.1, 4000HF:1.9

[O= Allowed X= Not permitted]

Code	Function Name	Monitored data or setting	Default Setting					Setting during operation (allowed or not)	Change during operation (allowed or not)		
			SJ700			SJ700B					
			-FE(CE)	-FU(UL)	-F(JP)	-F(AS)	-FU(UL)				
Others	b112	Free-setting V/f frequency (7)	0.0 to 400.0 (Hz) (*1)		0.	0.	0.	0.	0.	×	×
	b113	Free-setting V/f voltage (7)	0.0 to 800.0 (V)		0.0	0.0	0.0	0.0	0.0	×	×
	b120	Brake control enable	00 (disabling), 01 (enabling)		00	00	00	00	00	×	○
	b121	Brake wait time for release	0.00 to 5.00 (s)		0.00	0.00	0.00	0.00	0.00	×	○
	b122	Brake wait time for acceleration	0.00 to 5.00 (s)		0.00	0.00	0.00	0.00	0.00	×	○
	b123	Brake wait time for stopping	0.00 to 5.00 (s)		0.00	0.00	0.00	0.00	0.00	×	○
	b124	Brake wait time for confirmation	0.00 to 5.00 (s)		0.00	0.00	0.00	0.00	0.00	×	○
	b125	Brake release frequency setting	0.00 to 99.99, 100.0 to 400.0 (Hz) (*2)		0.00	0.00	0.00	0.00	0.00	×	○
	b126	Brake release current setting	0.0 to 2.00 x "rated current"		Rated current x 1.00					×	○
	b127	Braking frequency	0.00 to 99.99, 100.0 to 400.0 (Hz) (*2)		0.00	0.00	0.00	0.00	0.00	×	○
	b130	Overvoltage suppression enable	00 (disabling the restraint), 01 (decelerating and stagnating), 02 (enabling acceleration)		00	00	00	00	00	×	○
	b131	Overvoltage suppression level	330 to 390 (V) (200 V class model), 660 to 780 (V) (400 V class model)		380/760	380/760	380/760	380/760	380/760	×	○
	b132	Acceleration and deceleration rate at overvoltage suppression	0.10 to 30.00 (s)		1.00	1.00	1.00	1.00	1.00	×	○
	b133	Overvoltage suppression propotional gain	0.00 to 2.55		0.50	0.50	0.50	0.50	0.50	○	○
b134	Overvoltage suppression Integral time	0.000 to 9.999 / 10.00 to 63.53 (s)		0.060	0.060	0.060	0.060	0.060	○	○	

(\*1) 4000HF: 0.0 to 120.0(Hz) (\*2)4000HF: 0.00 to 99.99, 100.0 to 120.0(Hz)

**● C GROUP: INTELLIGENT TERMINAL FUNCTIONS**

[O= Allowed X= Not permitted]

Code		Function Name	Monitored data or setting	Default Setting					Setting during operation (allowed or not)	Change during operation (allowed or not)
				SJ700			SJ700B			
				-FE(CE)	-FU(UL)	-F(JP)	-F(AS)	-FU(UL)		
Intelligent input terminals	C001	Terminal [1] function (*1)	01 (RV: Reverse RUN), 02 (CF1: Multispeed 1 setting), 03 (CF2: Multispeed 2 setting), 04 (CF3: Multispeed 3 setting), 05 (CF4: Multispeed 4 setting), 06 (JG: Jogging), 07 (DB: external DC braking), 08 (SET: Set 2nd motor data), 09 (2CH: 2-stage acceleration/deceleration), 11 (FRS: free-run stop), 12 (EXT: external trip), 13 (USP: unattended start protection), 14: (CS: commercial power source enable), 15 (SFT: software lock), 16 (AT: analog input voltage/current select), 17 (SET3: 3rd motor control), 18 (RS: reset), 20 (STA: starting by 3-wire input), 21 (STP: stopping by 3-wire input), 22 (F/R: forward/reverse switching by 3-wire input), 23 (PID: PID disable), 24 (PIDC: PID reset), 26 (CAS: control gain setting), 27 (UP: remote control UP function), 28 (DWN: remote control DOWN function), 29 (DWN: remote control data clearing), 31 (OPE: forcible operation), 32 (SF1: multispeed bit 1), 33 (SF2: multispeed bit 2), 34 (SF3: multispeed bit 3), 35 (SF4: multispeed bit 4), 36 (SF5: multispeed bit 5), 37 (SF6: multispeed bit 6), 38 (SF7: multispeed bit 7), 39 (OLR: overload restriction selection), 40 (TL: torque limit enable), 41 (TRQ1: torque limit selection bit 1), 42 (TRQ2: torque limit selection bit 2), 43 (PPI: P/P mode selection), 44 (BOK: braking confirmation), 45 (ORT: orientation), 46 (LAC: LAD cancellation), 47 (PCLR: clearance of position deviation), 48 (STAT: pulse train position command input enable), 50 (ADD: trigger for frequency addition [A145]), 51 (F-TM: forcible-terminal operation), 52 (ATR: permission of torque command input), 53 (KHC: cumulative power clearance), 54 (SON: servo-on), 55 (FOC: pre-excitation), 56 (MI1: general-purpose input 1), 57 (MI2: general-purpose input 2), 58 (MI3: general-purpose input 3), 59 (MI4: general-purpose input 4), 60 (MI5: general-purpose input 5), 61 (MI6: general-purpose input 6), 62 (MI7: general-purpose input 7), 63 (MI8: general-purpose input 8), 64 (EMR: Emergency stop(*1), 65 (AHD: analog command holding), 66 (CP1: multistage position settings selection 1 ), 67 (CP2: multistage position settings selection 2), 68 (CP3: multistage position settings selection 3), 69 (ORL: Zero-return limit function), 70 (ORG: Zero-return trigger function), 71 (FOT: forward drive stop), 72 (ROT: reverse drive stop), 73 (SPD: speed / position switching), 74 (PCNT: pulse counter), 75 (PCC: pulse counter clear), no (NO: no assignment)	18(RS)	18(RS)	18(RS)	18(RS)	18(RS)	×	○
	C002	Terminal [2] function	16(AT)	16(AT)	16(AT)	16(AT)	16(AT)	×	○	
	C003	Terminal [3] function (*1)	06(JG)	06(JG)	06(JG)	06(JG)	03(CF2)	×	○	
	C004	Terminal [4] function	11(FRS)	11(FRS)	11(FRS)	11(FRS)	02(CF1)	×	○	
	C005	Terminal [5] function	09(2CH)	09(2CH)	09(2CH)	09(2CH)	01(RV)	×	○	
	C006	Terminal [6] function	03(CF2)	03(CF2)	13(USP)	03(CF2)	06(JG)	×	○	
	C007	Terminal [7] function	02(CF1)	02(CF1)	02(CF1)	02(CF1)	11(FRS)	×	○	
	C008	Terminal [8] function	01(RV)	01(RV)	01(RV)	01(RV)	13(USP)	×	○	
Intelligent input terminals	C011	Terminal (1) active state	00(NO) / 01(NC)	00	00	00	00	00	×	○
	C012	Terminal (2) active state	00(NO) / 01(NC)	00	00	00	00	00	×	○
	C013	Terminal (3) active state	00(NO) / 01(NC)	00	00	00	00	00	×	○
	C014	Terminal (4) active state	00(NO) / 01(NC)	00	00	00	00	00	×	○
	C015	Terminal (5) active state	00(NO) / 01(NC)	00	00	00	00	00	×	○
	C016	Terminal (6) active state	00(NO) / 01(NC)	00	01	00	00	00	×	○
	C017	Terminal (7) active state	00(NO) / 01(NC)	00	00	00	00	00	×	○
	C018	Terminal (8) active state	00(NO) / 01(NC)	00	00	00	00	00	×	○
	C019	Terminal FW active state	00(NO) / 01(NC)	00	00	00	00	00	×	○
Intelligent output terminals	C021	Terminal (11) function	00 (RUN: running), 01 (FA1: constant-speed reached), 02 (FA2: set frequency overreached), 03 (OL: overload notice advance signal (1)), 04 (OD: output deviation for PID control), 05 (AL: alarm signal), 06 (FA3: set frequency reached), 07 (OTQ: over-torque), 08 (IP: instantaneous power failure), 09 (UV: undervoltage), 10 (TRQ: torque limited), 11 (RNT: operation time over), 12 (ONT: plug-in time over), 13 (THM: thermal alarm signal), 19 (BRK: brake release), 20 (BER: braking error), 21 (ZS: 0 Hz detection signal), 22 (DSE: speed deviation maximum), 23 (POK: positioning completed), 24 (FA4: set frequency overreached 2), 25 (FA5: set frequency reached 2), 26 (OL2: overload notice advance signal (2)), 27 (ODc: Analog O disconnection detection), 28 (OIDc: Analog OI disconnection detection), 29 (O2Dc: Analog O2 disconnection detection), 31 (FBV: PID feedback comparison), 32 (NDc: communication line disconnection), 33 (LOG1: logical operation result 1), 34 (LOG2: logical operation result 2), 35 (LOG3: logical operation result 3), 36 (LOG4: logical operation result 4), 37 (LOG5: logical operation result 5), 38 (LOG6: logical operation result 6), 39 (WAC: capacitor life warning)(*)2, 40 (WAF: cooling-fan speed drop), 41 (FFR: starting contact signal), 42 (OHF: heat sink overheat warning), 43 (LOC: low-current indication signal), 44 (M01: general-purpose output 1), 45 (M02: general-purpose output 2), 46 (M03: general-purpose output 3), 47 (M04: general-purpose output 4), 48 (M05: general-purpose output 5), 49 (M06: general-purpose output 6), 50 (IRDY: inverter ready), 51 (FWR: forward rotation), 52 (RVR: reverse rotation), 53 (MJA: major failure), 54(WCO: window comparator O), 55(WCOI: window comparator OI), 56 (WCO2: window comparator O2) (When alarm code output is selected for "C062", functions "AC0" to "AC2" or "AC0" to "AC3" [ACn: alarm code output] are forcibly assigned to intelligent output terminals 11 to 13 or 11 to 14, respectively.)	01(FA1)	01(FA1)	01(FA1)	01(FA1)	01(FA1)	×	○
	C022	Terminal (12) function	00(RUN)	00(RUN)	00(RUN)	00(RUN)	00(RUN)	×	○	
	C023	Terminal (13) function	03(OL)	03(OL)	03(OL)	03(OL)	03(OL)	×	○	
	C024	Terminal (14) function	07(OTO)	07(OTO)	07(OTO)	07(OTO)	07(OTO)	×	○	
	C025	Terminal (15) function	40(WAF)	40(WAF)	40(WAF)	40(WAF)	40(WAF)	×	○	
	C026	Alarm relay terminal function	05(AL)	05(AL)	05(AL)	05(AL)	05(AL)	×	○	
Analog monitoring	C027	FM signal selection	00 (output frequency), 01 (output current), 02 (output torque), 03 (digital output frequency), 04 (output voltage), 05 (input power), 06 (electronic thermal overload), 07 (LAD frequency), 08 (digital current monitoring), 09 (motor temperature), 10 (heat sink temperature), 12 (general-purpose output YA0)	00	00	00	00	00	×	○
	C028	AM signal selection	00 (output frequency), 01 (output current), 02 (output torque), 04 (output voltage), 05 (input power), 06 (electronic thermal overload), 07 (LAD frequency), 09 (motor temperature), 10 (heat sink temperature), 11 (output torque [signed value]), 13 (general-purpose output YA1)	00	00	00	00	00	×	○
	C029	AMI signal selection	00 (output frequency), 01 (output current), 02 (output torque), 04 (output voltage), 05 (input power), 06 (electronic thermal overload), 07 (LAD frequency), 09 (motor temperature), 10 (heat sink temperature), 14 (general-purpose output YA2)	00	00	00	00	00	×	○

(\*1) When the emergency stop function is enabled (SW1 = ON), "18" (RS) and "64" (EMR) are forcibly written to parameters "C001" and "C003", respectively. (You cannot arbitrarily write "64" to "C001".) If the SW1 signal is turned off and then turned on, "no" (no assignment) is set in parameter "C003".

(\*2) 1850HF, 2200HF, 3150HF and 4000HF: The function is not provided.



Code		Function Name	Monitored data or setting	Default Setting					Setting during operation (allowed or not)	Change during operation (allowed or not)	
				SJ700			SJ700B				
				-FE(CE)	-FU(UL)	-F(JP)	-F(AS)	-FU(UL)			
Analog monitoring	C030	Digital current monitor reference value	SJ700:0.20 x "rated current" to 2.00 x "rated current" (A) / SJ700B:0.20 x "rated current" to 1.50 x "rated current" (A) (Current with digital current monitor output at 1,440 Hz)	Rated current of inverter x 1.00					○	○	
	Intelligent output terminals	C031	Terminal (11) active state	00(NO) / 01(NC)	00	00	00	00	00	×	○
		C032	Terminal (12) active state	00(NO) / 01(NC)	00	00	00	00	00	×	○
		C033	Terminal (13) active state	00(NO) / 01(NC)	00	00	00	00	00	×	○
		C034	Terminal (14) active state	00(NO) / 01(NC)	00	00	00	00	00	×	○
		C035	Terminal (15) active state	00(NO) / 01(NC)	00	00	00	00	00	×	○
		C036	Alarm relay terminal active state	00(NO) / 01(NC)	01	01	01	01	01	×	○
Levels and output terminal status	C038	Low-current indication signal output mode selection	00 (output during acceleration/deceleration and constant-speed operation), 01 (output only during constant-speed operation)	01	01	01	01	01	×	○	
	C039	Low-current indication signal detection level	SJ700:0.0 to 2.00 x "rated current" (A) / SJ700B:0.0 to 1.50 x "rated current" (A)	Rated current of inverter x 1.00					×	○	
	C040	Overload signal output mode	00 (output during acceleration/deceleration and constant-speed operation), 01 (output only during constant-speed operation)	01	01	01	01	01	×	○	
	C041	Overload level setting	SJ700:0.0 to 2.00 x "rated current" (A) / SJ700B:0.0 to 1.50 x "rated current" (A)	Rated current of inverter x 1.00					×	○	
	C042	Frequency arrival setting for accel.	0.00 to 99.99, 100.0 to 400.0 (Hz) (*1)	0.00	0.00	0.00	0.00	0.00	×	○	
	C043	Frequency arrival setting for decel.	0.00 to 99.99, 100.0 to 400.0 (Hz) (*1)	0.00	0.00	0.00	0.00	0.00	×	○	
	C044	PID deviation level setting	0.0 to 100.0 (%)	3.0	3.0	3.0	3.0	3.0	×	○	
	C045	Frequency arrival setting for acceleration (2)	0.00 to 99.99, 100.0 to 400.0 (Hz) (*1)	0.00	0.00	0.00	0.00	0.00	×	○	
	C046	Frequency arrival setting for deceleration (2)	0.00 to 99.99, 100.0 to 400.0 (Hz) (*1)	0.00	0.00	0.00	0.00	0.00	×	○	
	C052	Maximum PID feedback data	0.0 to 100.0 (%)	100.0	100.0	100.0	100.0	100.0	×	○	
	C053	Minimum PID feedback data	0.0 to 100.0 (%)	0.0	0.0	0.0	0.0	0.0	×	○	
	C055	Over-torque(Forward-driving) level setting	SJ700: 0. to 200. (%) < 75kW and over:0. to 180.> SJ700B: 0. to 150. (%)	100.	100.	100.	100.	100.	×	○	
	C056	Over-torque(Reverse-regenerating) level setting	SJ700: 0. to 200. (%) < 75kW and over:0. to 180.> SJ700B: 0. to 150. (%)	100.	100.	100.	100.	100.	×	○	
	C057	Over-torque(Reverse-driving) level setting	SJ700: 0. to 200. (%) < 75kW and over:0. to 180.> SJ700B: 0. to 150. (%)	100.	100.	100.	100.	100.	×	○	
	C058	Over-torque(Forward-regenerating) level setting	SJ700: 0. to 200. (%) < 75kW and over:0. to 180.> SJ700B: 0. to 150. (%)	100.	100.	100.	100.	100.	×	○	
	C061	Electronic thermal warning level setting	0. to 100. (%)	80.	80.	80.	80.	80.	×	○	
	C062	Alarm code input	00(Disabled) / 01(3-bit) / 02(4-bit)	00	00	00	00	00	×	○	
	C063	Zero speed detection level	0.00 to 99.99, 100.0 (Hz)	0.00	0.00	0.00	0.00	0.00	×	○	
C064	Heat sink overheat warning level	0. to 200.0 (°C)	120.	120.	120.	120.	120.	×	○		
Communication function	C071	Communication speed selection	02 (loopback test), 03 (2,400 bps), 04 (4,800 bps), 05 (9,600 bps), 06 (19,200 bps)	04	04	04	04	04	×	○	
	C072	Node allocation	1. to 32.	1.	1.	1.	1.	1.	×	○	
	C073	Communication data length selection	7 (7 bits), 8 (8 bits)	7	7	7	7	7	×	○	
	C074	Communication parity selection	00 (no parity), 01 (even parity), 02 (odd parity)	00	00	00	00	00	×	○	
	C075	Communication stop bit selection	1 (1 bit), 2 (2 bits)	1	1	1	1	1	×	○	
	C076	Selection of the operation after communication error	00 (tripping), 01 (tripping after decelerating and stopping the motor), 02 (ignoring errors), 03 (stopping the motor after free-running), 04 (decelerating and stopping the motor)	02	02	02	02	02	×	○	
	C077	Communication timeout limit before tripping	0.00 to 99.99 (s)	0.00	0.00	0.00	0.00	0.00	×	○	
Adjustment	C078	Communication wait time	0. to 1000. (ms)	0.	0.	0.	0.	0.	×	○	
	C079	Communication mode selection	00(ASCII), 01(Modbus-RTU)	00	00	00	00	00	×	○	
	C081	O input span calibration	0. to 9999., 1000 to 6553(10000 to 65530)	Factory set					×	○	
	C082	O1 input span calibration	0. to 9999., 1000 to 6553(10000~65530)						×	○	
	C083	O2 input span calibration	0. to 9999., 1000 to 6553(10000~65530)						×	○	
	C085	Thermistor input tuning	0.0 to 999.9, 1000.						×	○	
	C091	Debug mode enable	(Do not change this parameter, which is intended for factory adjustment.)	00	00	00	00	00	×	×	
Others	C101	UP/DOWN memory mode selection	00 (not storing the frequency data), 01 (storing the frequency data)	00	00	00	00	00	×	○	
	C102	Reset mode selection	00 (resetting the trip when RS is on), 01 (resetting the trip when RS is off), 02 (enabling resetting only upon tripping [resetting when RS is on])	00	00	00	00	00	○	○	
	C103	Restart mode after reset	00 (starting with 0 Hz), 01 (starting with matching frequency), 02 (restarting with active matching frequency)	00	00	00	00	00	×	○	
Meter adjustment	C105	FM gain adjustment	50. to 200. (%)	100.	100.	100.	100.	100.	○	○	
	C106	AM gain adjustment	50. to 200. (%)	100.	100.	100.	100.	100.	○	○	
	C107	AMI gain adjustment	50. to 200. (%)	100.	100.	100.	100.	100.	○	○	
	C109	AM bias adjustment	0. to 100. (%)	0.	0.	0.	0.	0.	○	○	
	C110	AMI bias adjustment	0. to 100. (%)	20.	20.	20.	20.	20.	○	○	
	C111	Overload setting (2)	SJ700:0.0 to 2.00 x "rated current" (A) <75kW and over:0.0 to 1.80 x "rated current"> SJ700B:0.0 to 1.50 x "rated current" (A)	Rated current of inverter x 1.00					×	○	
Adjustment	C121	O input zero calibration	0. to 9999., 1000 to 6553 (10000 to 65530)	Factory set					○	○	
	C122	O1 input zero calibration	0. to 9999., 1000 to 6553 (10000 to 65530)						○	○	
	C123	O2 input zero calibration	0. to 9999., 1000 to 6553 (10000 to 65530)						○	○	
Output terminal operation function	C130	Output 11 on-delay time	0.0 to 100.0 (s)	0.0	0.0	0.0	0.0	0.0	○	○	
	C131	Output 11 off-delay time	0.0 to 100.0 (s)	0.0	0.0	0.0	0.0	0.0	×	○	
	C132	Output 12 on-delay time	0.0 to 100.0 (s)	0.0	0.0	0.0	0.0	0.0	×	○	
	C133	Output 12 off-delay time	0.0 to 100.0 (s)	0.0	0.0	0.0	0.0	0.0	×	○	
	C134	Output 13 on-delay time	0.0 to 100.0 (s)	0.0	0.0	0.0	0.0	0.0	×	○	
	C135	Output 13 off-delay time	0.0 to 100.0 (s)	0.0	0.0	0.0	0.0	0.0	×	○	
	C136	Output 14 on-delay time	0.0 to 100.0 (s)	0.0	0.0	0.0	0.0	0.0	×	○	
	C137	Output 14 off-delay time	0.0 to 100.0 (s)	0.0	0.0	0.0	0.0	0.0	×	○	
	C138	Output 15 on-delay time	0.0 to 100.0 (s)	0.0	0.0	0.0	0.0	0.0	×	○	
	C139	Output 15 off-delay time	0.0 to 100.0 (s)	0.0	0.0	0.0	0.0	0.0	×	○	
	C140	Output RY on-delay time	0.0 to 100.0 (s)	0.0	0.0	0.0	0.0	0.0	×	○	
	C141	Output RY off-delay time	0.0 to 100.0 (s)	0.0	0.0	0.0	0.0	0.0	×	○	
	C142	Logical output signal 1 selection 1	Same as the settings of C021 to C026 (except those of LOG1 to LOG6)	00	00	00	00	00	×	○	
	C143	Logical output signal 1 selection 2	Same as the settings of C021 to C026 (except those of LOG1 to LOG6)	00	00	00	00	00	×	○	
	C144	Logical output signal 1 operator selection	00 (AND), 01 (OR), 02 (XOR)	00	00	00	00	00	×	○	
	C145	Logical output signal 2 selection 1	Same as the settings of C021 to C026 (except those of LOG1 to LOG6)	00	00	00	00	00	×	○	
	C146	Logical output signal 2 selection 2	Same as the settings of C021 to C026 (except those of LOG1 to LOG6)	00	00	00	00	00	×	○	
	C147	Logical output signal 2 operator selection	00 (AND), 01 (OR), 02 (XOR)	00	00	00	00	00	×	○	
C148	Logical output signal 3 selection 1	Same as the settings of C021 to C026 (except those of LOG1 to LOG6)	00	00	00	00	00	×	○		

(\*1) 4000HF:0.00 to 99.99, 100.0 to 120.0(Hz)

[O= Allowed X= Not permitted]

Code	Function Name	Monitored data or setting	Default Setting					Setting during operation (allowed or not)	Change during operation (allowed or not)					
			SJ700			SJ700B								
			-FE(CE)	-FU(UL)	-F(UP)	-F(AS)	-FU(UL)							
Output terminal operation function	C149	Logical output signal 3 selection 2	Same as the settings of C021 to C026 (except those of LOG1 to LOG6)					00	00	00	00	00	×	○
	C150	Logical output signal 3 operator selection	00 (AND), 01 (OR), 02 (XOR)					00	00	00	00	00	×	○
	C151	Logical output signal 4 selection 1	Same as the settings of C021 to C026 (except those of LOG1 to LOG6)					00	00	00	00	00	×	○
	C152	Logical output signal 4 selection 2	Same as the settings of C021 to C026 (except those of LOG1 to LOG6)					00	00	00	00	00	×	○
	C153	Logical output signal 4 operator selection	00 (AND), 01 (OR), 02 (XOR)					00	00	00	00	00	×	○
	C154	Logical output signal 5 selection 1	Same as the settings of C021 to C026 (except those of LOG1 to LOG6)					00	00	00	00	00	×	○
	C155	Logical output signal 5 selection 2	Same as the settings of C021 to C026 (except those of LOG1 to LOG6)					00	00	00	00	00	×	○
	C156	Logical output signal 5 operator selection	00 (AND), 01 (OR), 02 (XOR)					00	00	00	00	00	×	○
	C157	Logical output signal 6 selection 1	Same as the settings of C021 to C026 (except those of LOG1 to LOG6)					00	00	00	00	00	×	○
C158	Logical output signal 6 selection 2	Same as the settings of C021 to C026 (except those of LOG1 to LOG6)					00	00	00	00	00	×	○	
C159	Logical output signal 6 operator selection	00 (AND), 01 (OR), 02 (XOR)					00	00	00	00	00	×	○	
Input terminal response	C160	Input terminal response time setting 1	0. to 200. (×2ms)					1	1	1	1	1	×	○
	C161	Input terminal response time setting 2	0. to 200. (×2ms)					1	1	1	1	1	×	○
	C162	Input terminal response time setting 3	0. to 200. (×2ms)					1	1	1	1	1	×	○
	C163	Input terminal response time setting 4	0. to 200. (×2ms)					1	1	1	1	1	×	○
	C164	Input terminal response time setting 5	0. to 200. (×2ms)					1	1	1	1	1	×	○
	C165	Input terminal response time setting 6	0. to 200. (×2ms)					1	1	1	1	1	×	○
	C166	Input terminal response time setting 7	0. to 200. (×2ms)					1	1	1	1	1	×	○
	C167	Input terminal response time setting 8	0. to 200. (×2ms)					1	1	1	1	1	×	○
	C168	Input terminal response time setting FW	0. to 200. (×2ms)					1	1	1	1	1	×	○
Other	C169	Multistage speed/position determination time	0. to 200. (×10ms)					0	0	0	0	0	×	○

## ● H GROUP: MOTOR CONSTANTS FUNCTIONS

[O= Allowed X= Not permitted]

Code			Function Name	Monitored data or setting	Default Setting					Setting during operation (allowed or not)	Change during operation (allowed or not)
					SJ700			SJ700B			
					-FE(CE)	-FU(UL)	-F(UP)	-F(AS)	-FU(UL)		
Control constants	H001	Auto-tuning Setting	00 (disabling auto-tuning), 01 (auto-tuning without rotation), 02 (auto-tuning with rotation)		00	00	00	00	00	×	×
	H002	Motor data selection, 1st motor	00 (Hitachi standard data), 01 (auto-tuned data), 02 (auto-tuned data [with online auto-tuning function])		00	00	00	00	00	×	×
	H202	Motor data selection, 2nd motor	00 (Hitachi standard data), 01 (auto-tuned data), 02 (auto-tuned data [with online auto-tuning function])		00	00	00	00	00	×	×
	H003	Motor capacity, 1st motor	SJ700:0.20 to 400.0 (kW)/SJ700B:0.20 to 160(kW)		Factory set					×	×
	H203	Motor capacity, 2nd motor	SJ700:0.20 to 400.0 (kW)/SJ700B:0.20 to 160(kW)							×	×
	H004	Motor poles setting, 1st motor	2, 4, 6, 8, 10 (poles)		4	4	4	4	4	×	×
	H204	Motor poles setting, 2nd motor	2, 4, 6, 8, 10 (poles)		4	4	4	4	4	×	×
	H005	Motor speed constant, 1st motor	0.001 to 9.999, 10.00 to 80.00 (10.000 to 80.000)		1,590	1,590	1,590	1,590	1,590	○	○
	H205	Motor speed constant, 2nd motor	0.001 to 9.999, 10.00 to 80.00 (10.000 to 80.000)		1,590	1,590	1,590	1,590	1,590	○	○
	H006	Motor stabilization constant, 1st motor	0. to 255.		100.	100.	100.	100.	100.	○	○
	H206	Motor stabilization constant, 2nd motor	0. to 255.		100.	100.	100.	100.	100.	○	○
	H306	Motor stabilization constant, 3rd motor	0. to 255.		100.	100.	100.	100.	100.	○	○
	H020	Motor constant R1, 1st motor	0.001 to 9.999, 10.00 to 65.53 (Ω) (*1)		Depending on motor capacity					×	×
	H220	Motor constant R1, 2nd motor	0.001 to 9.999, 10.00 to 65.53 (Ω) (*1)							×	×
	H021	Motor constant R2, 1st motor	0.001 to 9.999, 10.00 to 65.53 (Ω) (*1)							×	×
	H221	Motor constant R2, 2nd motor	0.001 to 9.999, 10.00 to 65.53 (Ω) (*1)							×	×
	H022	Motor constant L, 1st motor	0.01 to 99.99, 100.0 to 655.3 (mH) (*2)							×	×
	H222	Motor constant L, 2nd motor	0.01 to 99.99, 100.0 to 655.3 (mH) (*2)							×	×
	H023	Motor constant Io	0.01 to 99.99, 100.0 to 655.3 (A) (*3)							×	×
	H223	Motor constant Io, 2nd motor	0.01 to 99.99, 100.0 to 655.3 (A) (*3)							×	×
	H024	Motor constant J	0.001 to 9.999, 10.00 to 99.99, 100.0 to 999.9, 1000. to 9999.							×	×
	H224	Motor constant J, 2nd motor	0.001 to 9.999, 10.00 to 99.99, 100.0 to 999.9, 1000. to 9999.							×	×
	H030	Auto constant R1, 1st motor	0.001 to 9.999, 10.00 to 65.53 (Ω) (*1)							×	×
	H230	Auto constant R1, 2nd motor	0.001 to 9.999, 10.00 to 65.53 (Ω) (*1)							×	×
	H031	Auto constant R2, 1st motor	0.001 to 9.999, 10.00 to 65.53 (Ω) (*1)							×	×
	H231	Auto constant R2, 2nd motor	0.001 to 9.999, 10.00 to 65.53 (Ω) (*1)							×	×
	H032	Auto constant L, 1st motor	0.01 to 99.99, 100.0 to 655.3 (mH) (*2)							×	×
	H232	Auto constant L, 2nd motor	0.01 to 99.99, 100.0 to 655.3 (mH) (*2)							×	×
	H033	Auto constant Io, 1st motor	0.01 to 99.99, 100.0 to 655.3 (A) (*3)							×	×
	H233	Auto constant Io, 2nd motor	0.01 to 99.99, 100.0 to 655.3 (A) (*3)							×	×
	H034	Auto constant J, 1st motor	0.001 to 9.999, 10.00 to 99.99, 100.0 to 999.9, 1000. to 9999.							×	×
	H234	Auto constant J, 2nd motor	0.001 to 9.999, 10.00 to 99.99, 100.0 to 999.9, 1000. to 9999.							×	×
Control constants	H050	PI proportional gain for 1st motor	0.0 to 999.9, 1000.		100.0	100.0	100.0	100.0	100.0	○	○
	H250	PI proportional gain for 2nd motor	0.0 to 999.9, 1000.		100.0	100.0	100.0	100.0	100.0	○	○
	H051	PI integral gain for 1st motor	0.0 to 999.9, 1000.		100.0	100.0	100.0	100.0	100.0	○	○
	H251	PI integral gain for 2nd motor	0.0 to 999.9, 1000.		100.0	100.0	100.0	100.0	100.0	○	○
	H052	P proportional gain setting for 1st motor	0.01 to 10.00		1.00	1.00	1.00	1.00	1.00	○	○
	H252	P proportional gain setting for 2nd motor	0.01 to 10.00		1.00	1.00	1.00	1.00	1.00	○	○
	H060	Zero LV lmit for 1st motor	0.0 to 100.0		100.	100.	100.	70.	70.	○	○
	H260	Zero LV lmit for 2nd motor	0.0 to 100.0		100.	100.	100.	70.	70.	○	○
	H061	Zero LV starting boost current for 1st motor	0. to 50. (%)		50.	50.	50.	50.	50.	○	○
	H261	Zero LV starting boost current for 2nd motor	0. to 50. (%)		50.	50.	50.	50.	50.	○	○
	H070	Terminal selection PI proportional gain setting	0.0 to 999.9, 1000.		100.0	100.0	100.0	100.0	100.0	○	○
	H071	Terminal selection PI integral gain setting	0.0 to 999.9, 1000.		100.0	100.0	100.0	100.0	100.0	○	○
	H072	Terminal selection P proportional gain setting	0.00 to 10.00		1.00	1.00	1.00	1.00	1.00	○	○
	H073	Gain switching time	0. to 9999. (ms)		100.	100.	100.	100.	100.	○	○

(\*1) 1850HF,2200HF,3150HF and 4000HF:0.1 to 999.9,1000. to 6553.(mΩ).

(\*2) 1850HF,2200HF,3150HF and 4000HF:0.001 to 9.999,10.00. to 65.53(mH).

(\*3) 1850HF,2200HF,3150HF and 4000HF:0.01 to 0.35 " rated current "(A).

## ● P GROUP: EXPANSION CARD FUNCTIONS

[○= Allowed ×= Not permitted]

Code	Function Name	Monitored data or setting	Default Setting					Setting during operation (allowed or not)	Change during operation (allowed or not)					
			SJ700			SJ700B								
			-FE(CE)	-FU(UL)	-F(JP)	-F(AS)	-FU(UL)							
Output terminal operation function	P001	Operation mode on expansion card 1 error	00 (tripping), 01 (continuing operation)	00	00	00	00	00	×	○				
	P002	Operation mode on expansion card 2 error	00 (tripping), 01 (continuing operation)	00	00	00	00	00	×	○				
	P011	Encoder pulse-per-revolution (PPR) setting	128. to 9999., 1000 to 6500 (10000 to 65000) (pulses)	1024	1024	1024	1024	1024	×	×				
	P012	Control pulse setting	00 (ASR), 01 (APR), 02 (APR2), 03 (HAPR)	00	00	00	00	00	×	×				
	P013	Pulse input mode setting	00 (mode 0), 01 (mode 1), 02 (mode 2)	00	00	00	00	00	×	×				
	P014	Home search stop position setting	0. to 4095.	0.	0.	0.	0.	0.	×	○				
	P015	Home search speed setting	"start frequency" to "maximum frequency" (up to 120.0) (Hz)	5.00	5.00	5.00	5.00	5.00	×	○				
	P016	Home search direction setting	00 (forward), 01 (reverse)	00	00	00	00	00	×	×				
	P017	Home search completion range setting	0. to 9999., 1000 (10000) (pulses)	5.	5.	5.	5.	5.	×	○				
	P018	Home search completion delay time setting	0.00 to 9.99 (s)	0.00	0.00	0.00	0.00	0.00	×	○				
	P019	Electronic gear set position selection	00 (feedback side), 01 (commanding side)	00	00	00	00	00	×	○				
	P020	Electronic gear ratio numerator setting	0. to 9999.	1.	1.	1.	1.	1.	×	○				
	P021	Electronic gear ratio denominator setting	0. to 9999.	1.	1.	1.	1.	1.	×	×				
	P022	Feed-forward gain setting	0.00 to 99.99, 100.0 to 655.3	0.00	0.00	0.00	0.00	0.00	×	○				
	P023	Position loop gain setting	0.00 to 99.99, 100.0	0.50	0.50	0.50	0.50	0.50	×	○				
	P024	Position bias setting	-204 (-2048.) / -999. to 2048	0.	0.	0.	0.	0.	×	○				
	P025	Temperature compensation thermistor enable	00 (no compensation), 01 (compensation)	00	00	00	00	00	×	○				
	P026	Over-speed error detection level setting	0.0 to 150.0 (%)	135.0	135.0	135.0	135.0	135.0	×	○				
	P027	Speed deviation error detection level setting	0.00 to 99.99, 100.0 to 120.0 (Hz)	7.50	7.50	7.50	7.50	7.50	×	×				
	P028	Numerator of motor gear ratio	0. to 9999.	1.	1.	1.	1.	1.	×	○				
	P029	Denominator of motor gear ratio	0. to 9999.	1.	1.	1.	1.	1.	×	○				
	P031	Accel./decel. time input selection	00 (digital operator), 01 (option 1), 02 (option 2), 03 (easy sequence)	00	00	00	00	00	×	×				
	P032	Positioning command input selection	00 (digital operator), 01 (option 1), 02 (option 2)	00	00	00	00	00	×	○				
	P033	Torque command input selection	00 (O terminal), 01 (OI terminal), 02 (O2 terminal), 03 (digital operator)	00	00	00	00	00	×	×				
	P034	Torque command setting	0. to 200. (%)	0.	0.	0.	0.	0.	○	○				
	P035	Polarity selection at the torque command input via O2 terminal	00 (as indicated by the sign), 01 (depending on the operation direction)	00	00	00	00	00	×	×				
	P036	Torque bias mode	00 (disabling the mode), 01 (digital operator), 02 (input via O2 terminal)	00	00	00	00	00	×	×				
	P037	Torque bias value	-200. to +200. (%)	0.	0.	0.	0.	0.	○	○				
	P038	Torque bias polarity selection	00 (as indicated by the sign), 01 (depending on the operation direction)	00	00	00	00	00	×	×				
	P039	Speed limit for torque-controlled operation (forward rotation)	0.00 to "maximum frequency" (Hz)	0.00	0.00	0.00	0.00	0.00	○	○				
	P040	Speed limit for torque-controlled operation (reverse rotation)	0.00 to "maximum frequency" (Hz)	0.00	0.00	0.00	0.00	0.00	○	○				
	P044	DeviceNet comm watchdog timer	0.00 to 99.99 (s)	1.00	1.00	1.00	1.00	1.00	×	×				
	P045	Inverter action on DeviceNet comm error	00 (tripping), 01 (tripping after decelerating and stopping the motor), 02 (ignoring errors), 03 (stopping the motor after free-running), 04 (decelerating and stopping the motor)	01	01	01	01	01	×	×				
	P046	DeviceNet polled I/O : Output instance number	20, 21, 100	21	21	21	21	21	×	×				
P047	DeviceNet polled I/O : input instance number	70, 71, 101	71	71	71	71	71	×	×					
P048	Inverter action on DeviceNet idle mode	00 (tripping), 01 (tripping after decelerating and stopping the motor), 02 (ignoring errors), 03 (stopping the motor after free-running), 04 (decelerating and stopping the motor)	01	01	01	01	01	×	×					
P049	DeviceNet motor poles setting for RPM	0, 2, 4, 6, 8, 10, 12, 14, 16, 18, 20, 22, 24, 26, 28, 30, 32, 34, 36, 38 (poles)	00	00	00	00	00	×	×					
P055	Pulse-string frequency scale	1.0 to 50.0 (kHz)	25.0	25.0	25.0	25.0	25.0	×	○					
P056	Time constant of pulse-string frequency filter	0.01 to 2.00 (s)	0.10	0.10	0.10	0.10	0.10	×	○					
P057	Pulse-string frequency bias	-100. to +100. (%)	0.	0.	0.	0.	0.	×	○					
P058	Pulse-string frequency limit	0. to 100. (%)	100.	100.	100.	100.	100.	×	○					
Absolute position control	P060	Multistage position setting 0-7	Position setting range reverse side – forward side (upper 4 digits including "-")					0	0	0	○	○		
	P067							0	0	0	○	○		
	P068	Zero-return mode selection	00(Low) / 01 (Hi1) / 00 (Hi2)					00	00	00	00	○	○	
	P069	Zero-return direction selection	00 (FW) / 01 (RV)					00	00	00	00	○	○	
	P070	Low-speed zero-return frequency	0.00 – 10.00 (Hz)					0.00	0.00	0.00	0.00	○	○	
	P071	High-speed zero-return frequency	0.00 – 99.99 / 100.0 – Maximum frequency setting, 1st motor (Hz)					0.00	0.00	0.00	0.00	○	○	
	P072	Position range specification (forward)	0 – 268435455 (when P012 = 02) 0 – 1073741823 (When P012 = 03) (upper 4 digits)					268435455					○	○
	P073	Position range specification (reverse)	-268435455 – 0 (when P012 = 02) -1073741823 - 0 (When P012 = 03) (upper 4 digits)					-268435455					○	○
sequence	P074	Teaching selection	00 (X00) / 01 (X01) / 02 (X02) / 03 (X03) / 04 (X04) / 05 (X05) / 06 (X06) / 07 (X07)					00	00	00	00	00	○	○
	P100 P131	Easy sequence user parameter U (00)-(31)	0. to 9999., 1000 to 6553 (10000 to 65535)					0.	0.	0.	0.	0.	○	○

## ● U GROUP: USER-SELECTABLE MENU FUNCTIONS

[○= Allowed ×= Not permitted]

Code		Function Name	Monitored data or setting	Default Setting					Setting during operation (allowed or not)	Change during operation (allowed or not)
				SJ700			SJ700B			
				-FE(CE)	-FU(UL)	-F(JP)	-F(AS)	-FU(UL)		
parameters	U001	User selected functions 1-12	no/d001 to P131	no	no	no	no	no	○	○
	P012									



# PROTECTIVE FUNCTIONS


Name	Cause(s)	Display on digital operator	Display on remote operator/copy unit
Over-current protection	The inverter output was short-circuited, or the motor shaft is locked or has a heavy load. These conditions cause excessive current for the inverter, so the inverter output is turned off.	While at constant speed	<b>E01</b> OC.Drive
		During deceleration	<b>E02</b> OC.Decel
		During acceleration	<b>E03</b> OC.Accel
		Others	<b>E04</b> Over.C
Overload protection(*1)	When a motor overload is detected by the electronic thermal function, the inverter trips and turns off its output.	<b>E05</b>	Over.L
Braking resistor overload protection	When the regenerative braking resistor exceeds the usage time allowance or an over-voltage caused by the stop of the BRD function is detected, the inverter trips and turns off its output.	<b>E06</b>	OL.BRD
Over-voltage protection	When the DC bus voltage exceeds a threshold, due to regenerative energy from the motor, the inverter trips and turns off its output.	<b>E07</b>	Over.V
EEPROM error(*2)	When the built-in EEPROM memory has problems due to noise or excessive temperature, the inverter trips and turns off its output.	<b>E08</b>	EEPROM
Under-voltage error	A decrease of internal DC bus voltage below a threshold results in a control circuit fault. This condition can also generate excessive motor heat or cause low torque. The inverter trips and turns off its output.	<b>E09</b>	Under.V
CT(Current transformer) error	If a strong source of electrical interference is close to the inverter or abnormal operations occur in the built-in CT, the inverter trips and turns off its output.	<b>E10</b>	CT
CPU error	When a malfunction in the built-in CPU has occurred, the inverter trips and turns off its output.	<b>E11</b>	CPU
External trip	When a signal to an intelligent input terminal configured as EXT has occurred, the inverter trips and turns off its output.	<b>E12</b>	EXTERNAL
USP error	An error occurs when power is cycled while the inverter is in RUN mode if the Unattended Start Protection (USP) is enabled. The inverter trips and does not go into RUN mode until the error is cleared.	<b>E13</b>	USP
Ground fault	The inverter is protected by the detection of ground faults between the inverter output and the motor during power-up tests. This feature protects the inverter only.	<b>E14</b>	GND.Flt.
Input over-voltage protection	When the input voltage is higher than the specified value, it is detected 60 seconds after power-up and the inverter trips and turns off its output.	<b>E15</b>	OV.SRC
Instantaneous power failure	When power is cut for more than 15ms, the inverter trips and turns off its output. If power failure continues, the error will be cleared. The inverter restarts if it is in RUN mode when power is cycled.	<b>E16</b>	Inst.P-F
Temperature error due to low cooling-fan speed	The inverter will display the error code shown on the right if the lowering of cooling-fan speed is detected at the occurrence of the temperature error described below.	<b>E20</b>	OH.stFAN
Inverter thermal trip	When the inverter internal temperature is higher than the specified value, the thermal sensor in the inverter module detects the higher temperature of the power devices and trips, turning off the inverter output.	<b>E21</b>	OH.FIN
Gate array error	Communication error has occurred between CPU and gate array.	<b>E23</b>	GA.COM
Phase loss detection	One of three lines of 3-phase power supply is missing.	<b>E24</b>	PH.Fail
Main circuit error (*3)	The inverter will trip if the gate array cannot confirm the on/off state of IGBT because of a malfunction due to noise or damage to the main circuit element.	<b>E25</b>	Main.Cir
Cooling-fan speed drop signal	If the rotation speed of the internal cooling fan decreases so that the cooling effect decreases, inverter output turns OFF for protection.(available only for SJ700 1850-4000)	<b>E29</b>	Fan. Slow
IGBT error	When an instantaneous over-current has occurred, the inverter trips and turns off its output to protect main circuit element.	<b>E30</b>	IGBT
Thermistor error	When the thermistor inside the motor detects temperature higher than the specified value, the inverter trips and turns off its output.	<b>E35</b>	TH
Braking error	The inverter turns off its output when it can not detect whether the braking is ON or OFF within waiting time set at b024 after it has released the brake. (When braking is enabled at b120)	<b>E36</b>	BRAKE
Emergency stop (*4)	If the EMR signal (on three terminals) is turned on when the slide switch (SW1) on the logic board is set to ON, the inverter hardware will shut off the inverter output and display the error code shown on the right.	<b>E37</b>	EMR
Low-speed overload protection	If overload occurs during the motor operation at a very low speed at 0.2 Hz or less, the electronic thermal protection circuit in the inverter will detect the overload and shut off the inverter output. (2nd electronic thermal control) (Note that a high frequency may be recorded as the error history data.)	<b>E38</b>	OL-LowSP
Modbus communication error	If timeout occurs because of line disconnection during the communication in Modbus-RTU mode, the inverter will display the error code shown on the right. (The inverter will trip according to the setting of "C076".)	<b>E41</b>	NET.ERR
Out of operation due to under-voltage	Due to insufficient voltage, the inverter has turned off its output and been trying to restart. If it fails to restart, it goes into the under-voltage error.	----	UV.WAIT
Easy sequence function Error	Error indications by protective functions with the easy sequence function used.	<b>E43</b>	PRG.CMD
		<b>E44</b>	PRG.NST
		<b>E45</b>	PRG.ERR1
Expansion card 1 connection error	An error has been detected in an expansion card or at its connecting terminals.	<b>E60~E69</b>	OP1-0 ~ OP1-9
Expansion card 2 connection error		<b>E70~E79</b>	OP2-0 ~ OP2-9

(\*1): Reset operation is acceptable 10 seconds after the trip.(185kW and over :90 seconds) (\*2): Check the parameters when EEPROM error occurs. (\*3): The inverter will not accept reset commands input via the RS terminal or entered by the STOP/RESET key. Therefore, turn off the inverter power. (\*4): The inverter will not accept the reset command entered from the digital operator. Therefore, reset the inverter by turning on the RS terminal.

## 〈Status Display〉

Code	Description	Code	Description	Code	Description	Code	Description	Code	Description
0	Reset	2	Deceleration	4	Acceleration	6	Starting	8	Overload Restriction
1	Stop	3	Constant Speed	5	f0 Stop	7	DB	9	Forcible or servo-on

## 〈How to access the details about the present fault〉

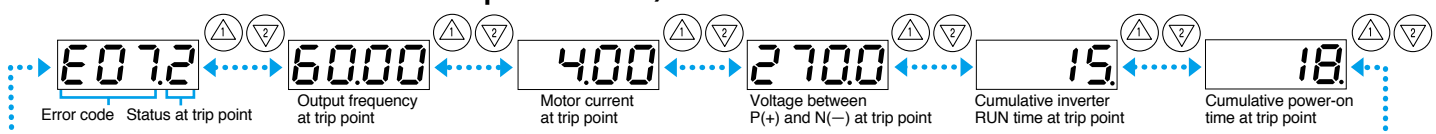


# TERMINALS

## Main Circuit Terminals

### Terminal Description

Terminal Symbol	Terminal Name	Terminal Symbol	Terminal Name
R(L1), S(L2), T(L3)	Main power supply input terminals	P(+), N(-)	External braking unit connection terminals
U(T1), V(T2), W(T3)	Inverter output terminals	⊕ (G)	Ground connection terminal
PD(+1), P(+)	DC reactor connection terminals	Ro(Ro), To(To)	Control power supply input terminals
P(+), RB(RB)	External braking resistor connection terminals		


### Screw Diameter and Terminal Width




Model		Screw diameter	Ground Screw diameter	Terminal width (mm)
SJ700				
004~037LFF2, LFUF2/007~037HFF2, HFEF2, HFUF2	055HF	M4	M4	13
055,075LFF2, LFUF2/HFF2, HFEF2, HFUF2	075,110HFF/ HFUF, 110LFUF	M5	M5	18
110LFF2, LFUF2/HFF2, HFEF2, HFUF2	150HFF/ HFUF/ LFUF	M6	M6	18
150,185LFF2, LFUF2/150-300HFF2, HFEF2, HFUF2	185-370HFF/ HFUF, 185,220LFUF	M6	M6	23
220,300LFF2, LFUF2	300,370LFUF	M8	M6	23
370,450LFF2, LFUF2/370-550HFF2, HFEF2, HFUF2	450-750HFF/ HFUF, 450,550LFUF	M8	M8	29
550LFF2, LFUF2	750LFUF	M10	M8	40
750,900HFF2, HFEF2, HFUF2	900,1100HFF/ HFUF	M10	M8	29
1100HFF2, HFEF2, HFUF2/1320HFF2, HFEF2/1500HFUF2	1320,1600HFF/ HFUF	M10	M8	40
1850,2200HF2, HFE2, HFU2	-	M16	M12	51
3150HF2, HFE2, HFU2	-	M16	M12	45
4000HF2, HFE2, HFU2	-	M12	M12	50
RoTo terminals (All models)		M4	-	9

### Terminal Arrangement


- SJ700-004-037LFUF2, LFF2/007-037HFEF2, HFUF2, HFF2
- SJ700B-055HF




- SJ700-1850, 2200HFE2, HFU2, HF2

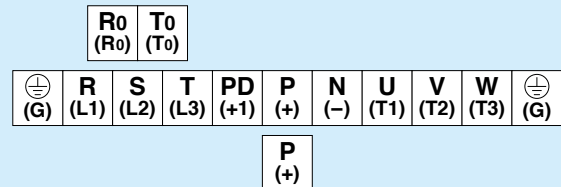


- SJ700-055-220LFUF2, LFF2, HFEF2, HFUF2, HFF2
- SJ700B-075-300HFF, HFUF, 110-300 LFUF

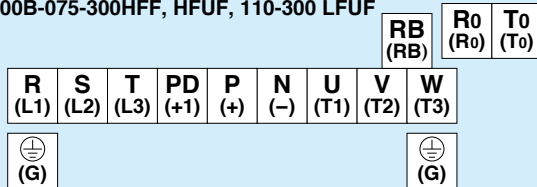


- SJ700-3150HFE2, HFU2, HF2

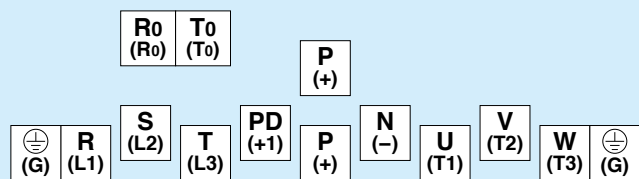


- SJ700-300-370LFUF2, LFF2, 300-550HFEF2, HFUF2, HFF2
- SJ700B-370-750HFF, HFUF, 370-450LFUF

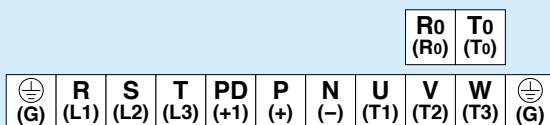

- SJ700-4000HFE2, HFU2, HF2

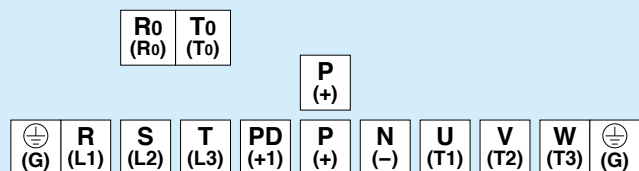


- SJ700-450-550LFUF2, LFF2, 750-1100HFEF2, HFUF2, HFF2
- 1320HFEF2, HFF2/1500HFUF2
- SJ700B-900-1600HFF, HFUF, 550-750LFUF

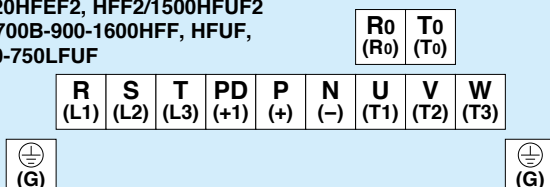

# TERMINALS

## Control Circuit Terminals

### ● Terminal Description

			Symbol	Name	Explanation of Terminals	Ratings	
Analog	Power Supply		L	Common Terminal for Analog Power Source	Common terminal for H, O, O2, OI, AM, and AMI. Do not ground.	-	
			H	Power Source for Frequency Setting	Power supply for frequency command input	DC 10V, 20mA max.	
	Frequency Setting		O	Frequency Command Terminal	Maximum frequency is attained at DC 10V in DC 0-10V range. Set the voltage at A014 to command maximum frequency below DC 10V.	Input impedance: 10kΩ, Allowable input voltage range: DC -0.3~+12V	
			O2	Frequency Command Extra Terminal	O2 signal is added to the frequency command of O or OI in DC 0~±10V range. By changing configuration, frequency command can be input also at O2 terminal.	Input impedance:10kΩ, Allowable input voltage range: DC 0~±12V	
			OI	Frequency Command Terminal	Maximum frequency is attained at DC 20mA in DC 4-20mA range. When the intelligent terminal configured as AT is on, OI signal is enabled.	Input impedance: 100Ω, Allowable input voltage range: DC 0-24mA	
	Monitor Output		AM	Analog Output Monitor (Voltage)	Selection of one function from: Output frequency, output current, torque, output voltage, input power, electronic thermal load ratio, and LAD frequency.	DC 0-10V, 2mA max.	
			AMI	Analog Output Monitor (Current)		DC 4-20mA, 250Ω max.	
Digital	Monitor Output		FM	Digital Monitor (Voltage)	[DC0-10V output (PWM output)] Selection of one function from: Output frequency, output current, torque, output voltage, input power, electronic thermal load ratio, and LAD frequency. [Digital pulse output (Pulse voltage DC 0/10V)] Outputs the value of output frequency as digital pulse (duty 50%)	Digital output frequency range: 0-3.6kHz, 1.2mA max.	
			Power Supply		P24	Power Terminal for Interface	Internal power supply for input terminals. In the case of source type logic, common terminal for contact input terminals.
	CM1	Common Terminal for Interface			Common terminal for P24, TH, and FM. In the case of sink type logic, common terminal for contact input terminals. Do not ground.	-	
	Contact Input		Run Command	FW	Forward Command Input	The motor runs forward when FW terminal is ON, and stops when FW is OFF.	[Input ON condition] Voltage between each terminal and PLC: DC 18V min.  [Input OFF condition] Voltage between each terminal and PLC: DC 3V max.  Input impedance between each terminal and PLC: 4.7Ω  Allowable maximum voltage between each terminal and PLC: DC 27V
			Functions	1 2 3 4 5 6 7 8	Intelligent Input Terminals	Assign 8 functions to terminals. (Refer to the standard specifications for the functions.)	
	Common Terminal	PLC	Common Terminal for Intelligent Input Terminals, Common Terminal for External Power Supply for PLCs, etc.	Select sink or source logic with the short-circuit bar on the control terminals. Sink logic: Short P24 to PLC / Source logic: Short CM1 to PLC. When applying external power source, remove the short-circuit bar and connect PLC terminal to the external device.	Allowable maximum voltage between each terminal and PLC: DC 27V		
		Open Collector Output		11 12 13 14 15	Intelligent Output Terminals	Assign 5 functions to open collector outputs. When the alarm code is selected at C062, terminal 11-13 or 11-14 are reserved for error codes of inverter trip. (Refer to the standard specifications for the functions.)	Decrease in voltage between each terminal and CM2: 4V max. during ON
	Both sink and source logic are always applicable between each terminal and CM1.					Allowable maximum voltage: DC 27V	
	CM2			Common Terminal for Intelligent Output Terminals	Common terminal for intelligent output terminal 11-15.	Allowable maximum current: 50mA	
	Analog	Analog Input	Sensor	TH	Thermistor Input Terminals	The inverter trips when the external thermistor detects abnormal temperature. Common terminal is CM1. [Recommended thermistor characteristics] Allowable rated power: 100mW or over. Impedance in the case of abnormal temperature: 3kΩ Note: Thermal protection level can be set between 0 and 9999Ω.	Allowable input voltage range  
	Digital	Relay Output	State/Alarm	AL0 AL1 AL2	Alarm Output Terminals	In default setting, an alarm is activated when inverter output is turned off by a protective function.	Maximum capacity of relays AL1-AL0: AC 250V, 2A(R load)/0.2A(L load) DC 30V, 8A(R load)/0.6A(L load) AL2-AL0:AC 250V, 1A(R load)/0.2A(L load) DC 30V, 1A(R load)/0.2A(L load) Minimum capacity of relays AL1-AL0, AL2-AL0: AC100V, 10mA DC5V, 100mA

### ● Terminal Arrangement

H	O2	AM	FM	TH	FW	8	CM1	5	3	1	14	13	11	AL1	
L	O	OI	AM1	P24	PLC	CM1	7	6	4	2	15	CM2	12	AL0	AL2

Screw diameter:M3                      Terminal Width:6.4mm

## Relay Output PCB(L300PTM)

L300PTM is available in case a relay output function is necessary.




Terminal Symbol	Specifications		
11A	Contacting Maximum Rate	AC250V	5A
11C			1A
12A			5A
12C	Contacting Minimum Rate	DC1V	1A
			1mA



# CONNECTING DIAGRAM

## ● Source type logic

200V class 200V-240V+10%, -15%  
50/60Hz±5%  
400V class 380V-480V+10%, -15%  
50/60Hz±5%

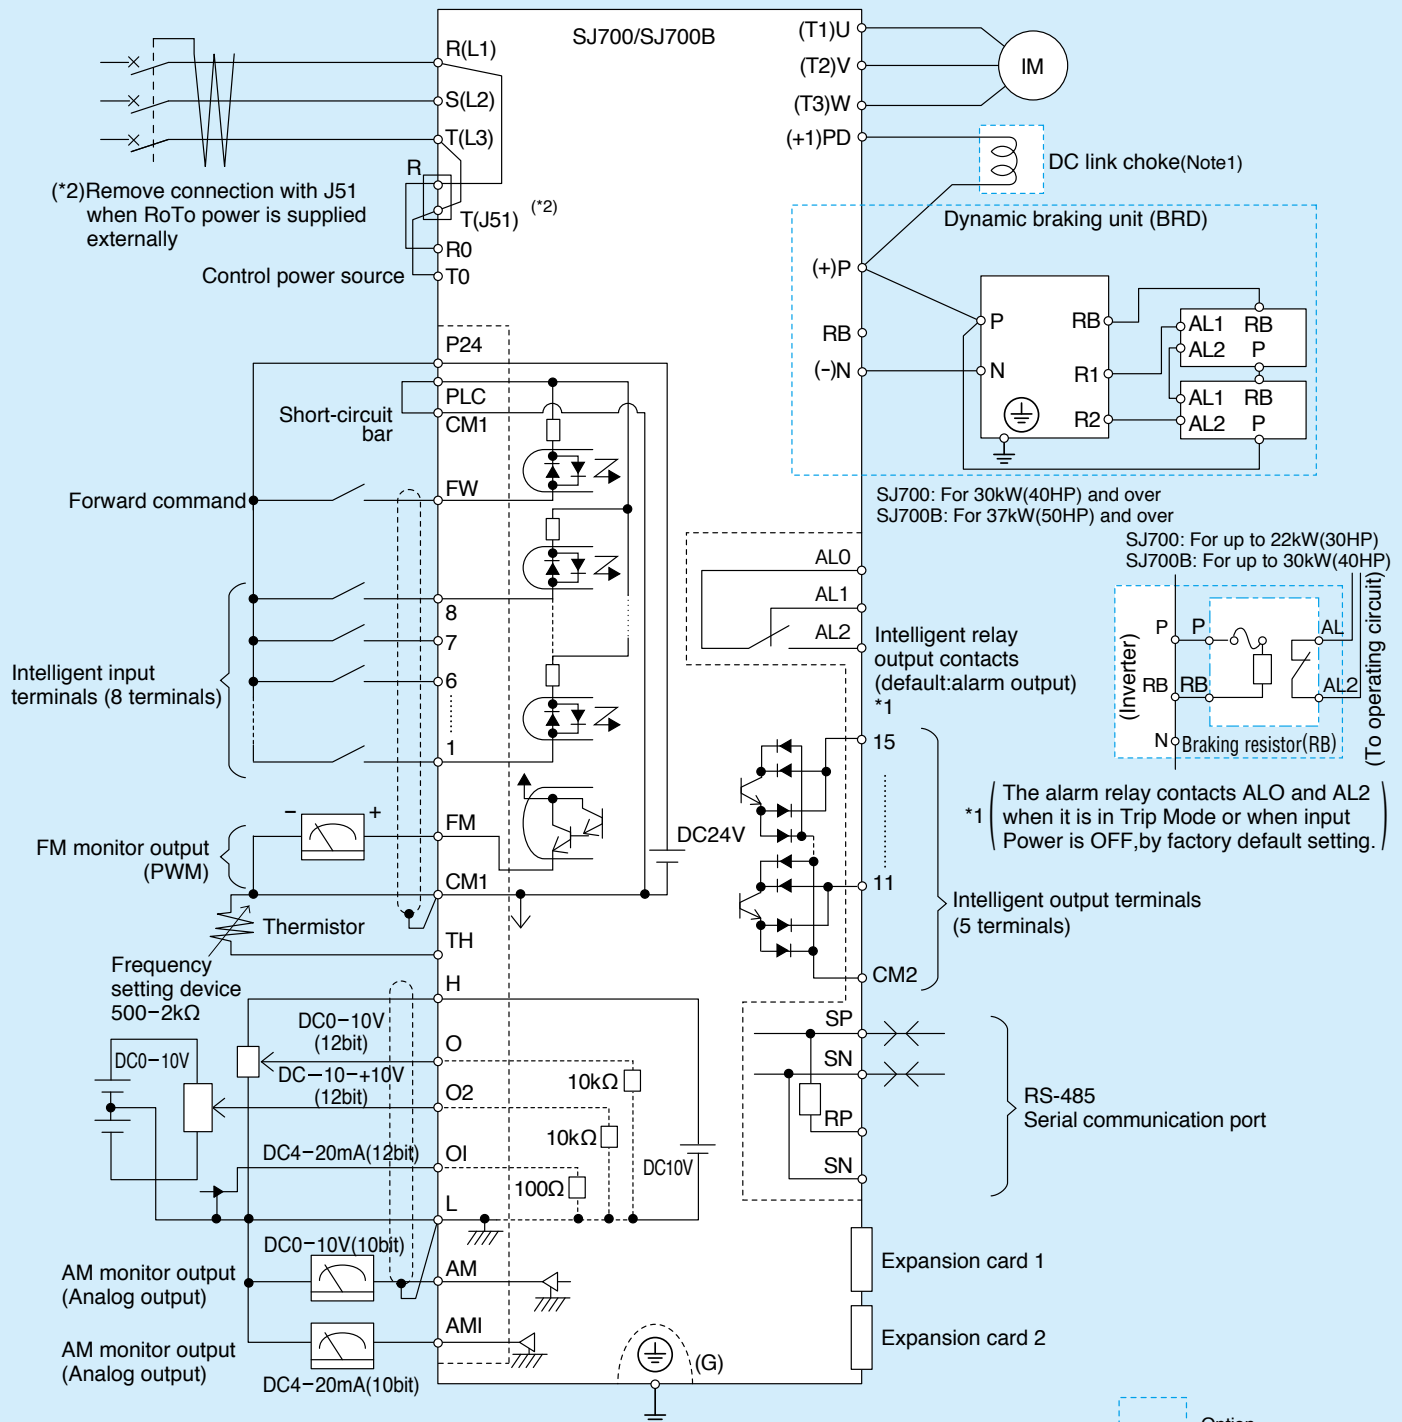

Terminal Name	FW, 1, 2, 3, 4, 5, 6, 7, 8	FM, TH	H, O, O2, OI, AM, AMI	11,12,13,14,15
Common terminal	P24	CM1	L	CM2


Note1: Please be sure to connect DC reactor attached to 1850HF, 2200HF, 3150HF and 4000HF.  
(1850HF, 2200HF and 3150HF of US/JP Version: DC reactor is not attached.)

# CONNECTING DIAGRAM

## ● Sink type logic

200V class 200V-240V+10%, -15%  
50/60Hz±5%

400V class 380V-480V+10%, -15%  
50/60Hz±5%

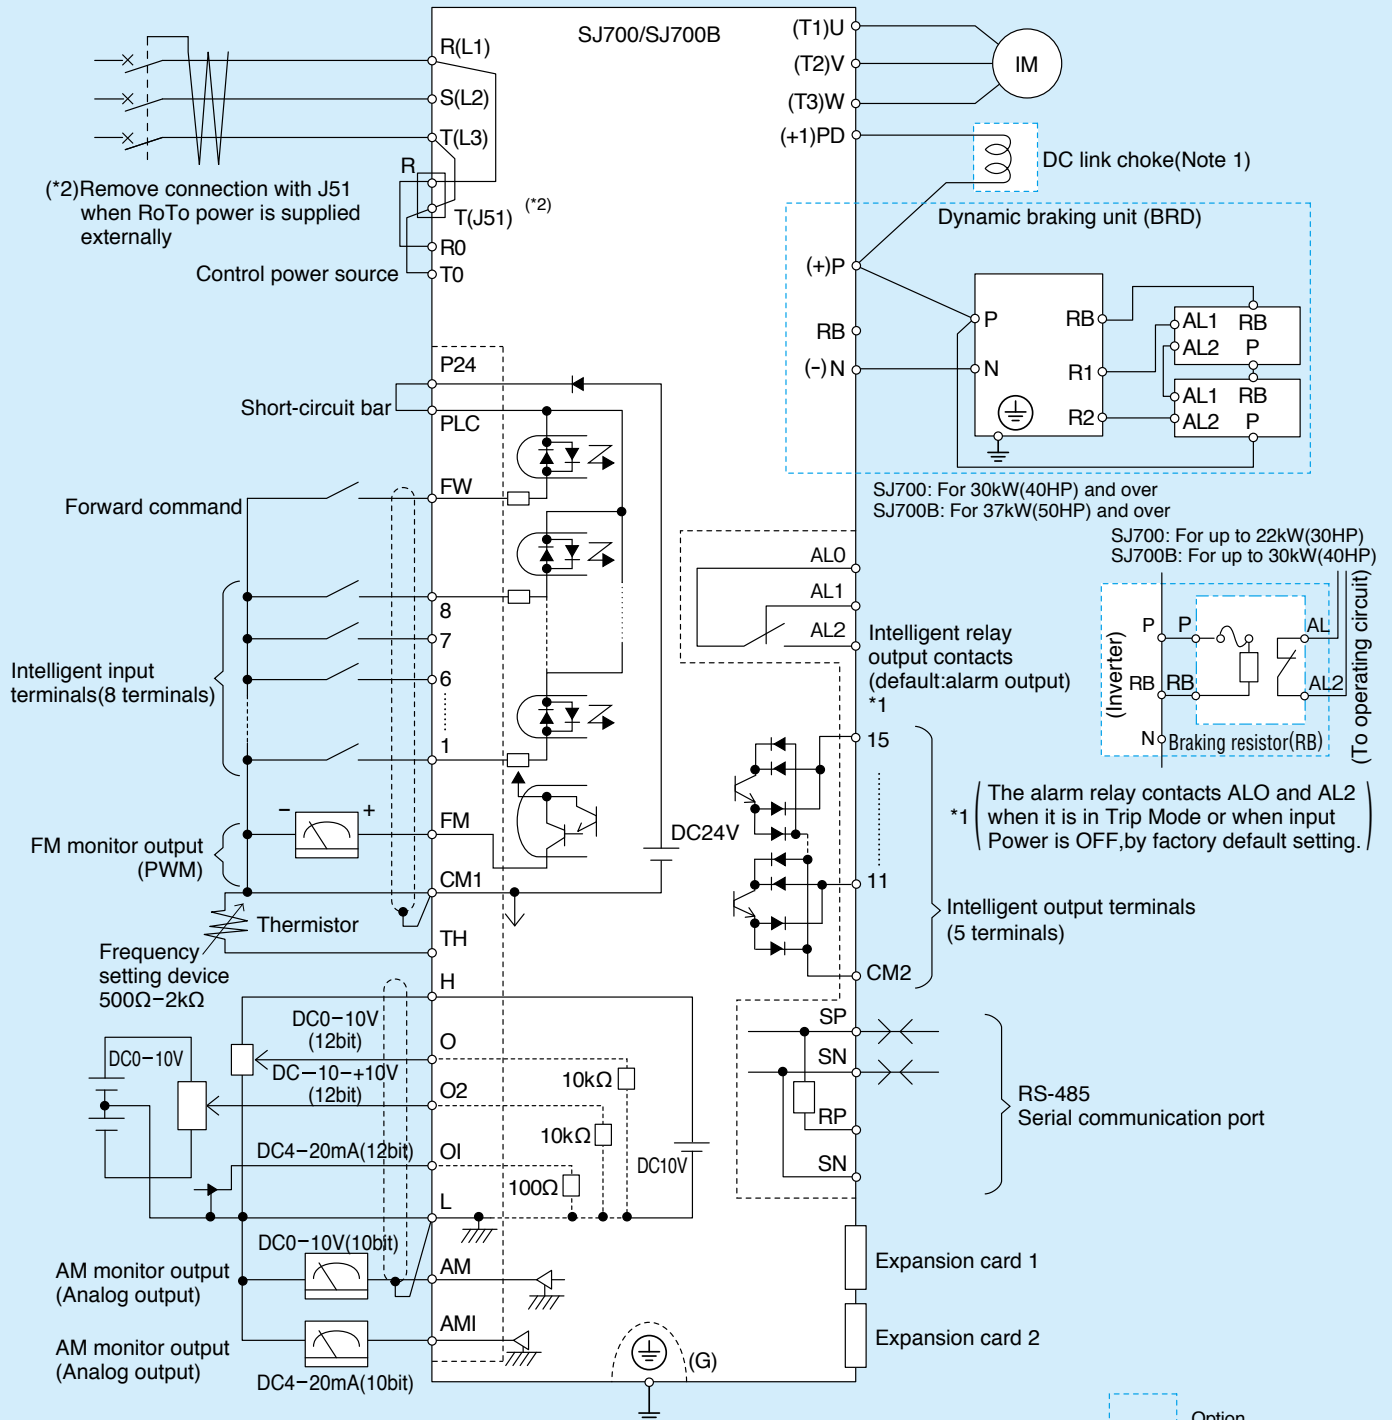

Terminal Name	FW, 1, 2, 3, 4, 5, 6, 7, 8, FM, TH	H, O, O2, OI, AM, AMI	11,12,13,14,15
Common terminal	CM1	L	CM2


Note1: Please be sure to connect DC reactor attached to 1850HF, 2200HF, 3150HF and 4000HF.  
(1850HF, 2200HF and 3150HF of US/JP Version: DC reactor is not attached.)

# CONNECTING TO PLC

## ● Connection with Input Terminals

### 1. Using Internal Power Supply of The Inverter


#### (1) Sink type logic

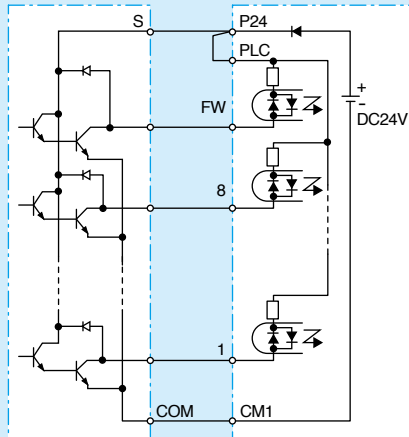

Hitachi EH-150 series PLC  
Output Module  
EH-YT16

Inverter

#### (2) Source type logic

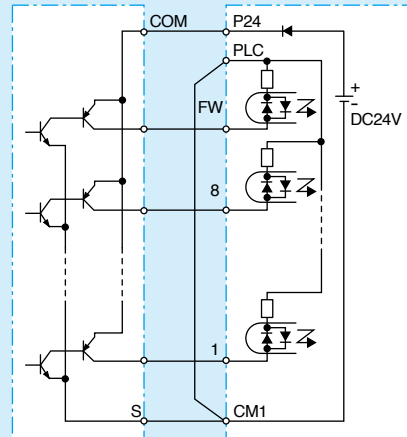


Hitachi EH-150 series PLC  
Output Module  
EH-YTP16

Inverter

(Note: Place short-circuit bar between PLC and CM1 instead of P24 and PLC)

### 2. Using External Power Supply

#### (1) Sink type logic

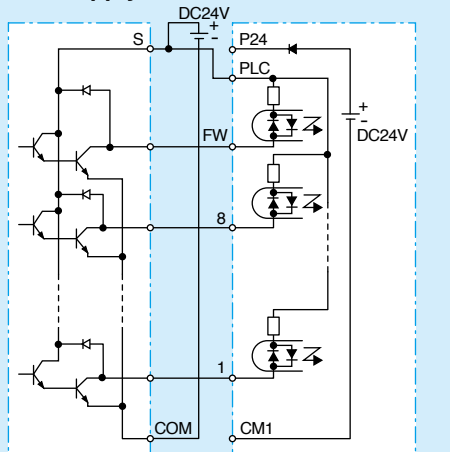


Hitachi EH-150 series PLC  
Output Module  
EH-YT16

Inverter

(Note: Remove short-circuit bar between P24 and PLC)

#### (2) Source type logic

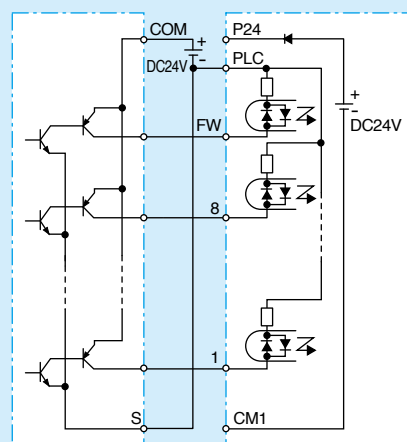


Hitachi EH-150 series PLC  
Output Module  
EH-YTP16

(Note: Remove short-circuit bar between P24 and PLC)

(Note: Be sure to turn on the inverter after turning on the PLC and its external power source to prevent the parameters in the inverter from being modified.)

## ● Connection with Output Terminals


#### (1) Sink type logic

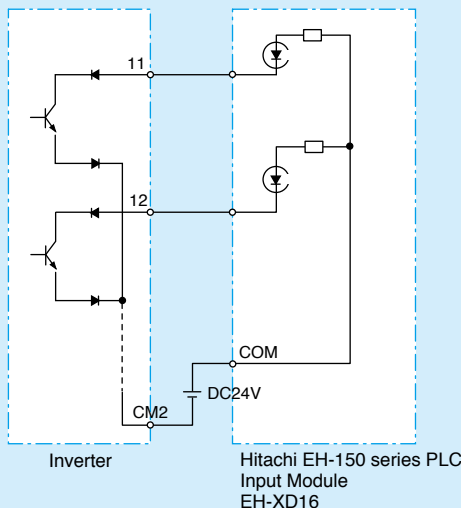

Inverter

Hitachi EH-150 series PLC  
Input Module  
EH-XD16

#### (2) Source type logic

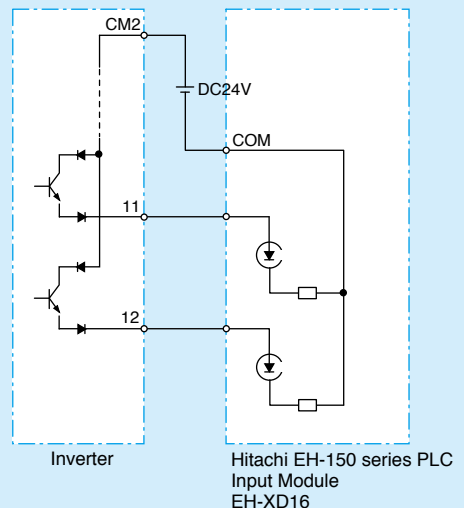


Inverter

Hitachi EH-150 series PLC  
Input Module  
EH-XD16



# WIRING and ACCESSORIES

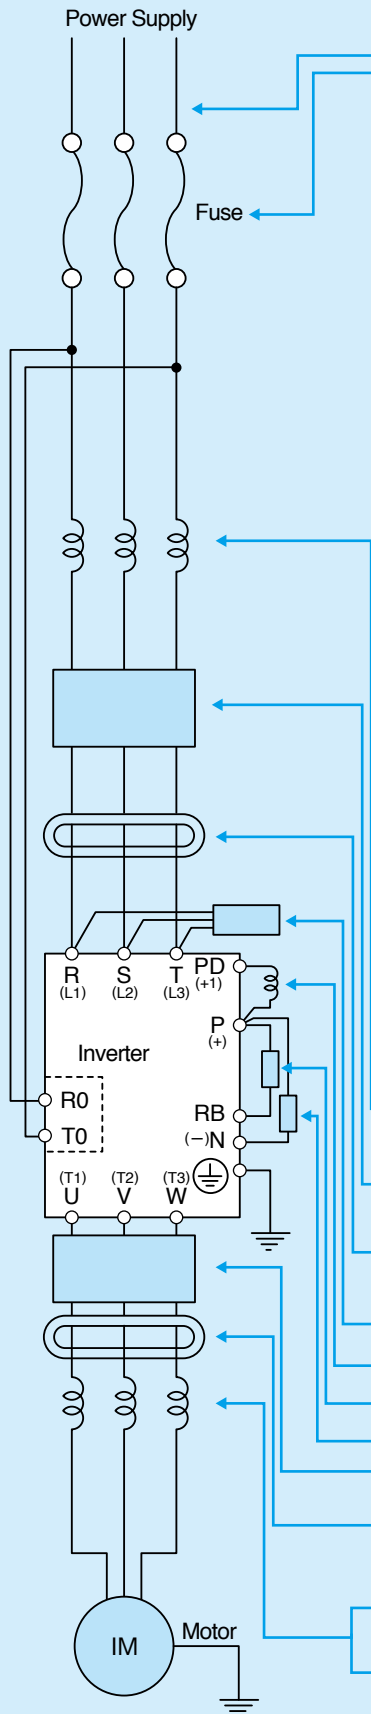

Input Voltage	Motor Output (kW(HP))	Model		Wiring				Signal Lines	Fuse (Class J)	
				Power Lines						
		AWG	mm²	AWG	mm²	Signal Lines	SJ700		SJ700B	
		SJ700	SJ700B				SJ700	SJ700B		
200V	0.4(1/2)	004LFUF2,LFF2	-	14	2.1	-		0.75mm² shielded wire	5	-
	0.75(1)	007LFUF2,LFF2	-	14	2.1	-			10	-
	1.5(2)	015LFUF2,LFF2	-	14	2.1	-			15	-
	2.2(3)	022LFUF2,LFF2	-	14	2.1	-			20	-
	3.7(5)	037LFUF2,LFF2	-	10	5.3	-			30	-
	5.5(7.5)	055LFUF2,LFF2	-	8	8.4	-			30	-
	7.5(10)	075LFUF2,LFF2	-	6	13.3	-			40	-
	11(15)	110LFUF2,LFF2	110LFUF	6	13.3	6	13.3		60	60
	15(20)	150LFUF2,LFF2	150LFUF	2	33.6	6	13.3		80	100
	18.5(25)	185LFUF2,LFF2	185LFUF	1	42.4	2	33.6		100	100
	22(30)	220LFUF2,LFF2	220LFUF	1	42.4	1	42.4		125	100
	30(40)	300LFUF2,LFF2	300LFUF	2/0	67.4	1	42.4		150	125
	37(50)	370LFUF2,LFF2	370LFUF	4/0	107.2	2/0	67.4		175	175
	45(60)	450LFUF2,LFF2	450LFUF	4/0	107.2	4/0	107.2		225	225
55(75)	550LFUF2,LFF2	550LFUF	2/0 x 2	67.4 x 2	4/0	107.2	250	250		
75(100)	-	750LFUF	-	-	2/0 x 2	67.4 x 2	-	300		
400V	0.75(1)	007HFEF2,HFUF2,HFF2	-	14	2.1	-		0.75mm² shielded wire	5	-
	1.5(2)	015HFEF2,HFUF2,HFF2	-	14	2.1	-			10	-
	2.2(3)	022HFEF2,HFUF2,HFF2	-	14	2.1	-			10	-
	3.7(5)	037HFEF2,HFUF2,HFF2	-	14	2.1	-			15	-
	5.5(7.5)	055HFEF2,HFUF2,HFF2	055HF	12	3.3	12	3.3		20	15
	7.5(10)	075HFEF2,HFUF2,HFF2	075HFF/HFUF	10	5.3	12	3.3		30	20
	11(15)	110HFEF2,HFUF2,HFF2	110HFF/HFUF	8	8.4	10	5.3		30	30
	15(20)	150HFEF2,HFUF2,HFF2	150HFF/HFUF	6	13.3	8	8.4		40	40
	18.5(25)	185HFEF2,HFUF2,HFF2	185HFF/HFUF	6	13.3	6	13.3		50	50
	22(30)	220HFEF2,HFUF2,HFF2	220HFF/HFUF	6	13.3	6	13.3		60	50
	30(40)	300HFEF2,HFUF2,HFF2	300HFF/HFUF	3	26.7	6	13.3		70	75
	37(50)	370HFEF2,HFUF2,HFF2	370HFF/HFUF	1	42.4	3	26.9		90	80
	45(60)	450HFEF2,HFUF2,HFF2	450HFF/HFUF	1	42.4	1	42.4		125	100
	55(75)	550HFEF2,HFUF2,HFF2	550HFF/HFUF	2/0	67.4	1	42.4		125	125
	75(100)	750HFEF2,HFUF2,HFF2	750HFF/HFUF	1/0 x 2	53.5 x 2	2/0	67.4		225	150
	90(125)	900HFEF2,HFUF2,HFF2	900HFF/HFUF	1/0 x 2	53.5 x 2	1/0 x 2	53.5 x 2		225	225
	110(150)	1100HFEF2,HFUF2,HFF2	1100HFF/HFUF	3/0 x 2	85.0 x 2	1/0 x 2	53.5 x 2		300	225
	132(175)	1320HFEF2,HFF2	1320HFF/HFUF	3/0 x 2	85.0 x 2	3/0 x 2	85.0 x 2		300	300
	150(200)	1500HFUF2	-	3/0 x 2	85.0 x 2	-			300	-
	160(220)	-	1600HFF/HFUF	-		3/0 x 2	85.0 x 2		-	350
	185(250)	1850HFE2,HFU2,HF2	-	300 x 2	152 x 2	-			700	-
	220(300)	2200HFE2,HFU2,HF2	-	350 x 2	177 x 2	-			700	-
315(400)	3150HFE2,HFU2,HF2	-	500 x 2	253 x 2	-		700	-		
400(550)	4000HFE2,HFU2,HF2	-	800 x 2	405 x 2	-		1000	-		

Note 1: Field wiring connection must be made by a UL and c-UL listed closed-loop terminal connector sized for the wire gauge involved. Connector must be fixed using the crimping tool specified by the connector manufacturer.

Note 2: Be sure to use large wire gauges for power wiring if the distance exceeds 20m (66ft).

Name	Function
Input side AC reactor	This is useful in suppressing harmonics induced on the power supply lines, or when the main power voltage imbalance exceeds 3% (and power source capacity is more than 500kVA), or to smooth out line fluctuations. It also improves the power factor.
EMI filter	Reduces the conducted noise on the power supply wiring generated by the inverter. Connect to the inverter input side.
Radio noise filter	Electrical noise interference may occur on nearby equipment such as a radio receiver. This magnetic choke filter helps reduce radiated noise (can also be used on output).
Radio noise filter (Capacitor filter)	This capacitor filter reduces radiated noise from the main power wires in the inverter input side.
DC link choke	Suppresses harmonics generated by the inverter.
Braking resistor	This is useful for increasing the inverter's control torque for high duty-cycle (on-off) applications, and improving the decelerating capability.
Braking unit	
Output side noise filter	Reduces radiated noise from wiring in the inverter output side.
Radio noise filter	Electrical noise interference may occur on nearby equipment such as a radio receiver. This magnetic choke filter helps reduce radiated noise (can also be used on input).
AC reactor	This reactor reduces the vibration in the motor caused by the inverter's switching waveforms, by smoothing the waveforms to approximate commercial power quality. It is also useful when wiring from the inverter to the motor is more than 10m in length, to reduce harmonics.
LCR filter	Sine wave shaping filter for the output side.

Note: An EMI filter is required for European EMC directive and C-Tick, but the others are not for this purpose.

# OPERATOR

## Operator, Cable


### Operator

Model	Potentiometer	Remote Control	Copy function	Applied Cable	Applied Model for Built-in
OPE-SR mini	<input type="radio"/>	<input type="radio"/>		•ICS-1(1m) •ICS-3(3m)	SJ200
OPE-SBK	<input type="radio"/>	<input type="radio"/>			Standard for SJ700,SJ700B
OPE-SR	<input type="radio"/>	<input type="radio"/>			SJ700,SJ700B
WOP	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>		SJ700,SJ700B,SJ300,L300P
SRW-0EX <sup>*1</sup>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>		SJ300,L300P

\*1) Production has been stopped.


### Cable

Cable <ICS-1,3>



Model	Cable Length
ICS-1	1m(3.3ft)
ICS-3	3m(9.8ft)

### 4X-KITmini (For installation with OPE-SR mini)

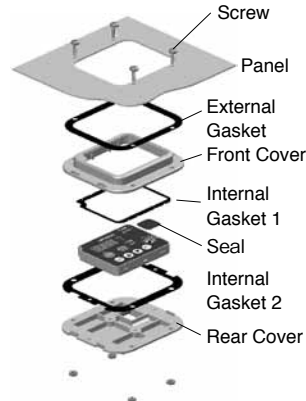

You can mount the keypad with the potentiometer for a NEMA1 rated installation. The kit also provides for removing the potentiometer knob to meet NEMA 4X requirements, as shown (part no.4X-KITmini).

## Operator

<OPE-SR mini>



<OPE-SBK(SR)>



<SRW-0J, SRW-0EX>



<WOP>




### For Furthermore Operation ..... Use option as WOP

#### Main Features for WOP :


- Large LCD screen
- Real time clock
- Copy function: Storing parameter settings of a total 4 units of inverters
- Multi-language (Japanese, English and Chinese) [ Planning to expand to 10 languages ] SJ700 and SJ700B is English only.
- Selectable display contents

### Dimensions (Unit:mm(inch) Inches for reference only)


<OPE-SR mini>

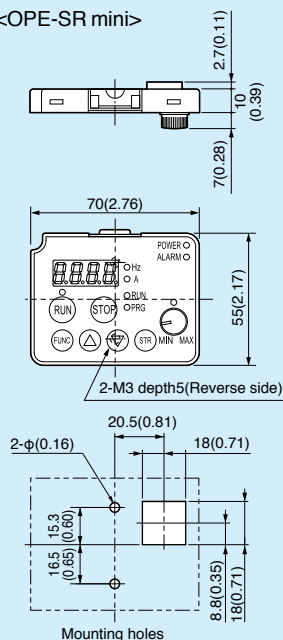

<OPE-SBK(SR)>

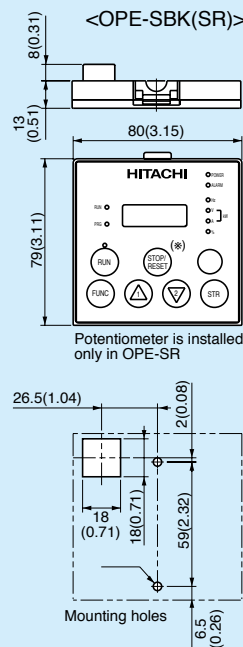

< SRW-0J, SRW-0EX, WOP>

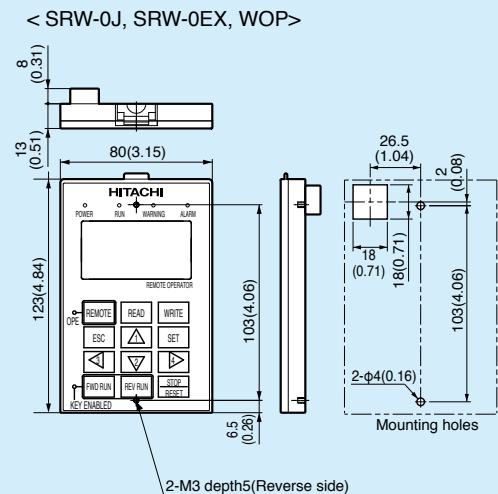

# EXPANSION CARD

## Digital Input Expansion Card SJ-DG


Output frequency, acceleration time, deceleration time, torque limit, and orientation position\*1 can be set by a digital output device such as PLC, etc. (Binary or BCD)

### Standard Specifications

Item		
Input	Data setting signal	
	Strobe signal	
Output	Sequence error signal (Data input error signal)	
Power supply	Power supply for interface	
Specification		
Input	NO contact input (sink/ source compatible)	D0,D1, ... between D15 and PLCB
		Between STRB and PLCB
Output	Open collector output (sink/ source compatible)	DC+27V 50mA max., between SEQ and CMB
Power supply	DC+24V 90mA max., between P24B and CM1	

\*1 Orientation position setting is enabled when the feedback PCB (SJ-FB) is used together.

### Connecting Diagram

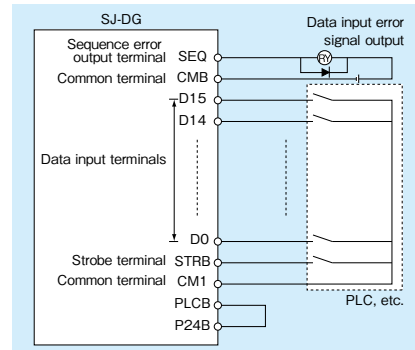

### Data Bit Configuration

Item	Mode1	Mode2
D15	Data classification code	Setting data
D14		
D13		
D12		
D11	Data can be set by either 16-bit binary or 4-digit BCD.	Data can be set by either 16-bit binary or 4-digit BCD.
D10		
D9		
D8		
D7	Input data is divided into upper 8-bit and lower 8-bit.	
D6		
D5		
D4		
D3	Setting data	
D2		
D1		
D0		

\*Data input mode is selected by the dip switch on the expansion card.


## Feedback Expansion Card SJ-FB

Detecting motor speed with an encoder and receiving the feedback suppress speed fluctuation and realize high-precision operation. Positioning control and orientation with pulse-train input are also possible.

### Application Examples

High-precision operation for the main motor of coil winding machine, wire drawing machine, truck, extruder, etc.

### Connecting Diagram (Example)

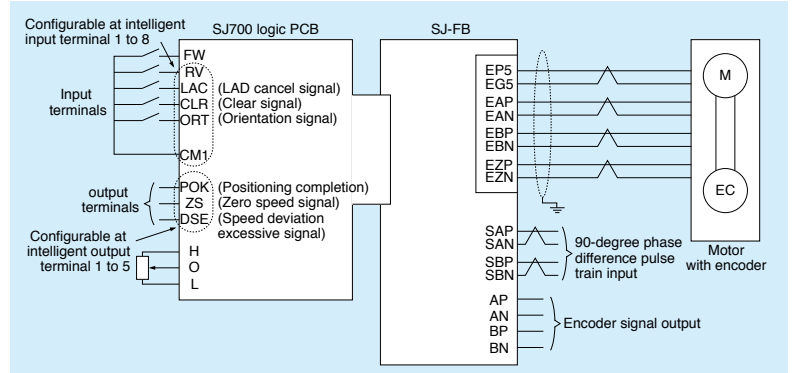

### General Specifications

Item		Specification
Speed control	Encoder feedback	Standard: 1024-pulse/r Maximum input pulse: 100k-pulse/s
	Speed control method	Proportional-Integral(PI) / Proportional(P) control
Position control	Positioning command	A-, B-phase, 90-degree phase difference input (By A-, B-, and Z-phase encoder), Maximum input pulse: 100k-pulse/s
	Electronic gear	Pulse ratio A/B (A, B: Setting range of 1-9999) 1/50 ≤ A/B ≤ 20
Orientation	Stop position	4096 splitting per motor's single revolution(When using standard encoder)
	Speed	Orientation speed and rotational direction can be set
Protective functions		Encoder cable disconnection protection, Over-speed protection, Positioning error


## DeviceNet™ EXPANSION CARD SJ-DN2

SJ-DN2 has DeviceNet™ functions, and it can perform network communication such as RUN/STOP, status monitoring, parameter setting, etc. by connecting with an upper level controller. Expensive hard-wiring can be eliminated for space saving and cost reduction, and installation/replacement within the system can be easily done.

### Specifications

General data		Applicable DeviceNet specification	
		CIP Volume I -Release3. 4 CIP Volume III-Release1. 5 DeviceNet Adaptation	
		Vendor name	Hitachi Industrial Equipment Systems Co.,Ltd.
		Vendor ID=1112	
Physical conformance data	Device profile name	Slave AC Drive	Profile No=2
	Product revision	2.1	
	Network consumption current	50mA	
	Connector type	Open connector	
	Isolation of physical layer	Yes	
	Support LED	Module status / network status	
	MAC ID setting	set at DipSW	
	Default MAC ID	00	
Communication data	Transmission baud rate setting	set at DipSW	
	Support transmission baud rate	125k/250k/500k	
	Pre-defined master/slave connection set	Group 2 only server	
	UCMM Support	None	
	Support connection	Explicit message connection, Polled I/O connection	
		Explicit message fragmentation	Yes

### Dimensional drawings [Unit:mm]

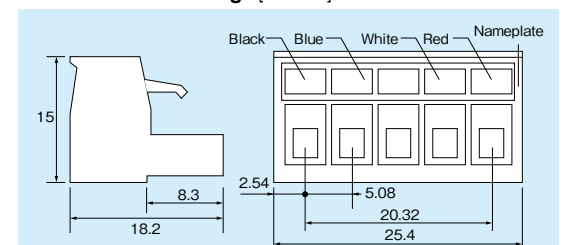

DeviceNet is a trademark of Open DeviceNet Vendor Association.

### Cable connection

No	Signal	Cable color
1	V-	Black
2	CAN_L	Blue
3	Drain	—
4	CAN_H	White
5	V+	Red

Note: Communication power supply (24VDC) is required in system configuration.




# TORQUE CHARACTERISTIC


## SJ700 Series / Maximum Torque with Short - Time Rating

Base frequency = 60Hz

Sensorless vector control

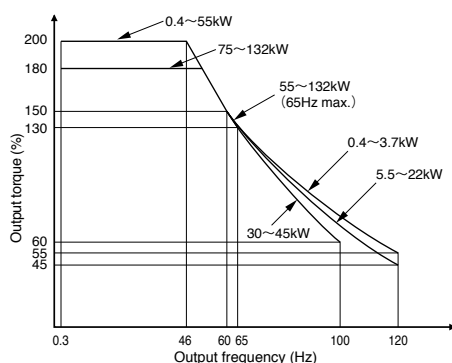


V/f control (maximum torque boosting)

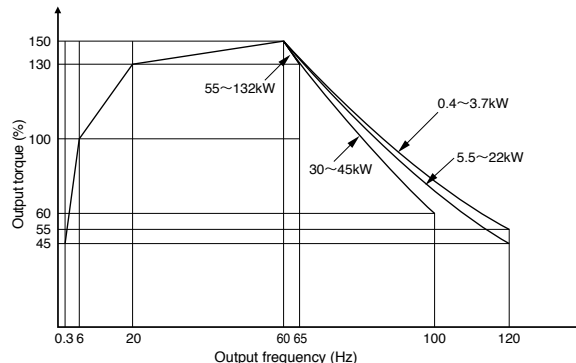


Base frequency = 50Hz

Sensorless vector control

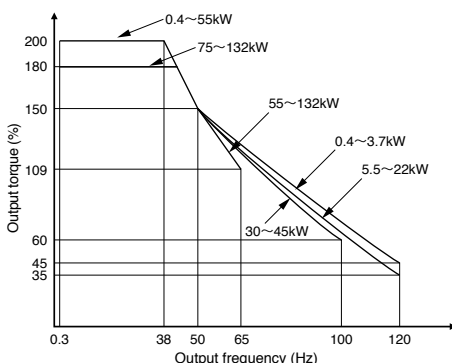


V/f control (maximum torque boosting)

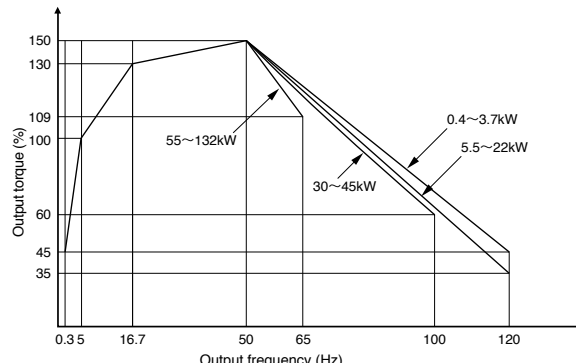


## SJ700B Series / Maximum Torque with Short - Time Rating

Base frequency = 60Hz

Sensorless vector control

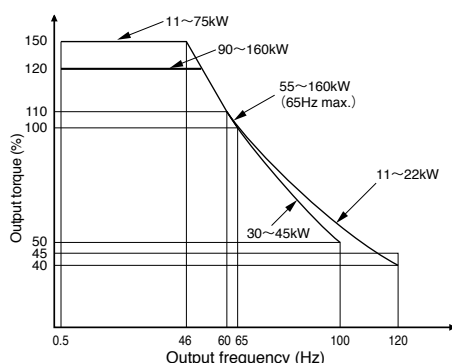


V/f control (maximum torque boosting)

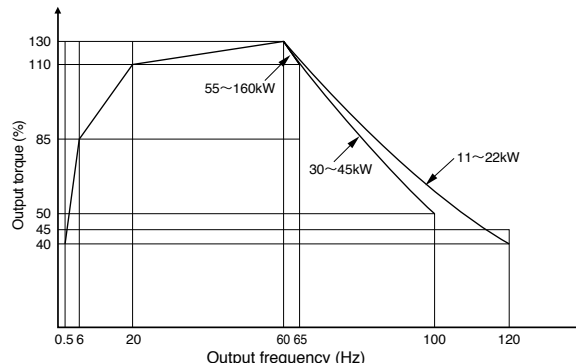


Base frequency = 50Hz

Sensorless vector control

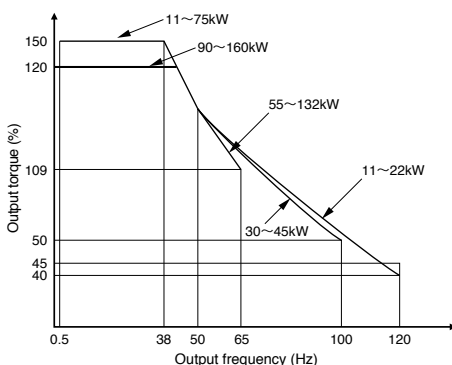


V/f control (maximum torque boosting)

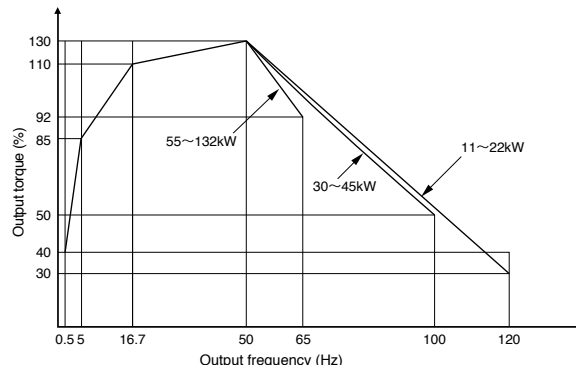


# TORQUE CHARACTERISTIC

## SJ700/SJ700B Series / Torque Under Continuous Operation

Base frequency = 60Hz

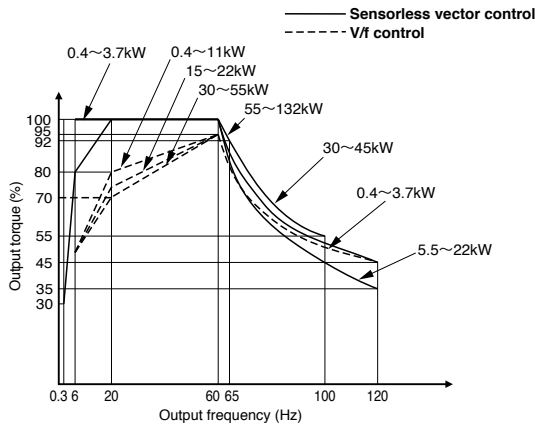


Base frequency = 50Hz

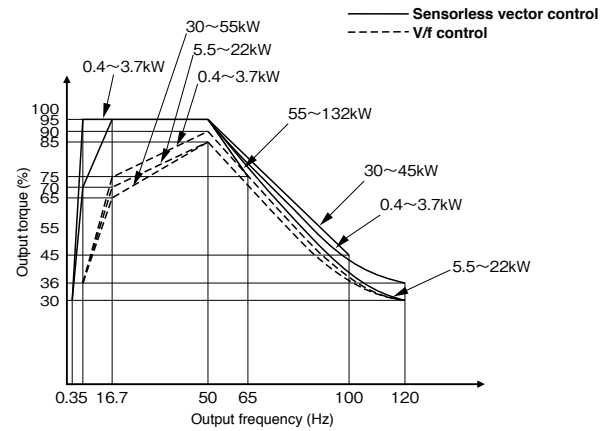


# DERATING DATA


## SJ700 200V class

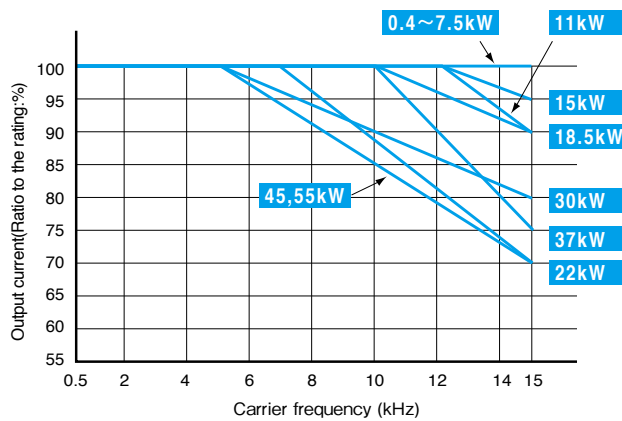


## SJ700 400V class

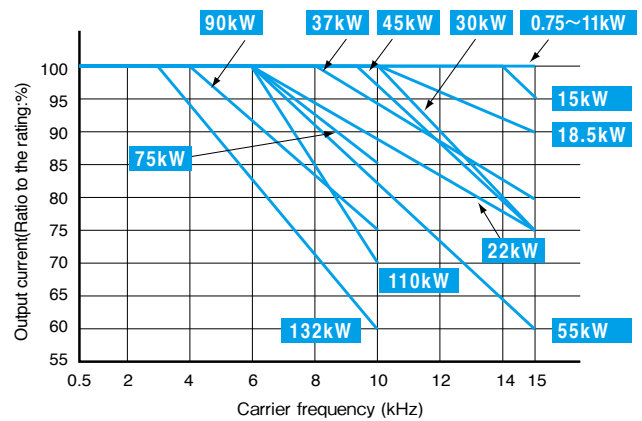

## SJ700B 200V class

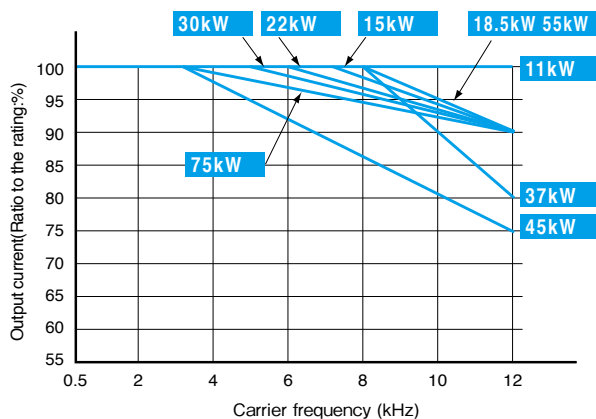

## SJ700B 400V class

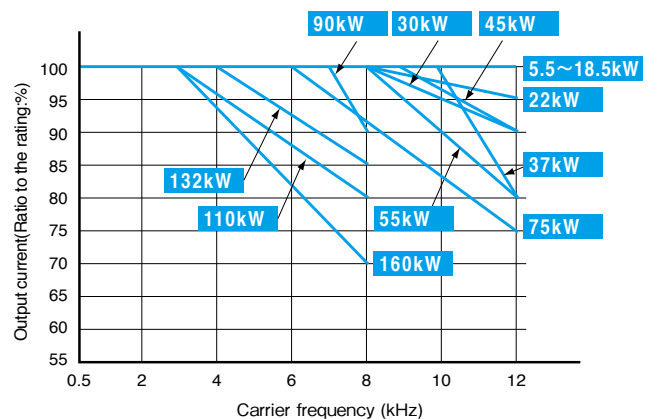

# DIFFERENCE and COMPATIBILITY of SJ300 series and SJ700 series

Items				SJ300 series		SJ700 series	
Copying the parameter settings				You can copy the parameter settings from the SJ300 series into the SJ700 series. (You cannot copy the parameter settings from the SJ700 series to the SJ300 series because the SJ700 series has many new functions and additional parameters.)			
Parameter display mode.				No display mode selection. (full display)		Basic display mode/Data comparison function addition. Note:basic display mode [factory setting]) To display all parameters, specify "00" for "b037".	
Change function		Retry or trip parameter		Instantaneous power failure/under-voltage/ overvoltage/overcurrent:It sets up by b001.		Instantaneous power failure/under-voltage:It sets up by b001. overvoltage/overcurrent:It sets up by b008.	
		d001: Output frequency monitoring d007: Scaled output frequency monitoring		You can not change the output frequency setting by using the △ and/or ▽ key.		You can not change the output frequency setting by using the △ and/or ▽ key.	
		A016:External frequency filter time const.		Default:8		Default:31 Note 1	
		A038:Jog frequency setting		Setting range:0 to 999Hz		Setting range: 0.01 to 999Hz(0Hz setup is impossible)	
		A105:[OI]-[L] input start frequency enable		Default:01(external start frequency)		Default:00(0Hz)	
		b012, b212, b312: Electronic thermal function		Setting upper limit:120%		Setting upper limit:100%	
		C025:Terminal [15] function		Default:08(instantaneous power failure)		Default:40(cooling-fan speed drop)	
Terminal	Control Circuit	Removable		Removable		Removable (You can mount the SJ300 series into the SJ700 series.)	
		Position		Other model:same position. 055L/H:5mm upper part from SJ300. 300L/H:97mm upper part from SJ300.			
	Main Circuit	Screw diameter	110L/H	M6(Ground Screw)		M5(Ground Screw)	
			300L	M8(Ground Screw)		M6(Ground Screw)	
			450L	M10		M8	
			370H	M6		M8	
		Position		055 to 110L/H:10mm upper part from SJ300. 300L:77mm upper part from SJ300. 300H:72mm upper part from SJ300. 150 to 185L/220H:29mm upper part from SJ300. 220L:18mm upper part from SJ300. 550L:25mm upper part from SJ300. Other model:same position.			
		Arrangement		055 to 110L/H:Two steps, 150 to 550L/H:One step		055 to 550L/H:One step	
Others		150 to 220L/H:RB there is not a terminal.		150 to 220L/H:RB there is a terminal.			
Easy-removable Dc bus Capacitor				All the models are possible.		15kW or more is possible.	
Dynamic Brake circuit				up to 11kW		up to 22kW	
Minimum value of resistor(Ω)		055L		17		16	
		075L		17		10	
		110L		17		10	
		055H		50		35	
		075H		50		35	
Dimensions		Installation		055L/H: SJ700 is in next larger enclosure vs. SJ300. All other models are the same enclosure size.			
		External radiating fin		055L/H:Those with no compatibility.075 to 550L/H:Those with compatibility. Note 2			
Digital operator position				055L/H:5mm upper part from SJ300. 300L/H:97mm upper part from SJ300. Other model:same position.			
Option boards		SJ-DG		Those with compatibility.			
		SJ-FB					
		SJ-DN / SJ-DN2		Those with compatibility. Note:Since the SJ700 series has many new functions and additional parameters, some functions of the SJ-DN, SJ-LW, and SJ-PBT (option boards conforming to the open network specifications) cannot be implemented on the SJ700 series. SJ-DN2 has compatibility to SJ700.			
		SJ-LW					
		SJ-PBT					
		Option position		Other model:same position. 055L/H:5mm upper part from SJ300. 300L/H:97mm upper part from SJ300.			

Note1:Since a response falls the V/F characteristic curve selection SLV should make this setup small.

Note2:370, 450L/H and 550H:Metal fittings differ.



# DIFFERENCE and COMPATIBILITY of L300P series and SJ700B series

Items			L300P series	SJ700B series	
Copying the parameter settings			You can copy the parameter settings from the L300P series into the SJ700B series. (You cannot copy the parameter settings from the SJ700B series to the L300P series because the SJ700B series has many new functions and additional parameters.)		
Parameter display mode.			No display mode selection. (full display)	Basic display mode/Data comparison function addition. Note:basic display mode [factory setting])To display all parameters, specify "00" for "b037".	
Change function	Retry or trip parameter		Instantaneous power failure/under-voltage/ overvoltage/overcurrent:It sets up by b001.	Instantaneous power failure/under-voltage:It sets up by b001. overvoltage/overcurrent:It sets up by b008.	
	d001:Output frequency monitoring d007:Scaled output frequency monitoring		You can not change the output frequency setting by using the up and or down key.	You can not change the output frequency setting by using the up and or down key.	
	A001: Frequency source setting		Default:00 (Keypad potentiometer on digital operator)	Default:02 (Digital operator)	
	A016: External frequency filter time const.		Default:8	Default:31 Note 1	
	A038:Jog frequency setting		Setting range:0 to 999Hz	Setting range: 0.01 to 999Hz(0Hz setup is impossible)	
	A105: [O]-[L] input start frequency enable		Default:01 (external start frequency)	Default:00(0Hz)	
	b012, b212, b312: Electronic thermal function		Setting upper limit:120%	Setting upper limit:100%	
	b013, b213, b313: Electronic thermal characteristic		Default:00 (reduced-torque characteristic)	Default:01 (constant-torque characteristic)	
	b092:Cooling fan control		Default:00 (always operating the fan)	Default:01 (operating the fan only during inverter operation [including 5 minutes after power-on and power-off])	
	b095:Dynamic braking control		Default:00 (disabling)	Default:01 (enabling [disabling while the motor is topped])	
Terminal	Control circuit	Removable		Removable (You can mount the L300P into the SJ700B .)	
		Intelligent input terminals		8 terminals	
		Intelligent output terminals		5 terminals(Open collector)	
		Position		370L/H:97mm upper part from L300P. Other model:same position.	
	Main circuit	Screw diameter	150L/H	M6(Ground Screw)	M5(Ground Screw)
			370L	M8(Ground Screw)	M6(Ground Screw)
			550L	M10	M8
			450H	M6	M8
		Position		110,150LF/HF:10mm upper part from L300P. 185 to 220L/300H:29mm upper part from L300P. 300L:18mm upper part from L300P. 370L:77mm upper part from L300P. 370H:72mm upper part from L300P. 750L:25mm upper part from L300P. Other model:same position.	
Others		185 to 300L/H:RB there is not a terminal.		185 to 300H:RB there is a terminal.	
Easy-removable Dc bus Capacitor			All the models are possible.		18.5kW or more is possible.
Dynamic Brake circuit			Up to 15kW		Up to 30kW
Minimum value of resistor(Ω)	110L		17		10
	150L		17		10
	110H		50		35
	150H		50		35
Dimensions	Installation		All models are the same enclosure size.		
	External radiating fin		Those with compatibility. Note 2		
Digital operator position			300L/H:97mm upper part from L300P. Other model:same position.		
Keypad potentiometer on digital operator			Yes.		No.(Option)
Option boards	SJ-DG		Those with compatibility.		
	SJ-DN / SJ-DN2		Those with compatibility.		
	SJ-LW		Note:Since the SJ700B series has many new functions and additional parameters,some functions of the SJ-DN, SJ-LW, and SJ-PBT(option boards conforming to the open network specifications)cannot be implemented on the SJ700B series. SJ-DN2 has compatibility to SJ700.		
	SJ-PBT				
	Option position		370L/H:97mm upper part from L300P. Other model:same position.		

Note1:Since a response falls the V/F characteristic curve selection SLV should make this setup small.

Note2:450, 550L/H and 750H:Metal fittings differ.

# FOR CORRECT OPERATION

## Application to Motors

### Application to general-purpose motors

Operating frequency	The overspeed endurance of a general-purpose motor is 120% of the rated speed for 2 minutes (JIS C4.004). For operation at higher than 60Hz, it is required to examine the allowable torque of the motor, useful life of bearings, noise, vibration, etc. In this case, be sure to consult the motor manufacturer as the maximum allowable rpm differs depending on the motor capacity, etc.
Torque characteristics	The torque characteristics of driving a general-purpose motor with an inverter differ from those of driving it using commercial power (starting torque decreases in particular). Carefully check the load torque characteristic of a connected machine and the driving torque characteristic of the motor.
Motor loss and temperature increase	The torque characteristics of driving a general-purpose motor with an inverter differ from those of driving it using commercial power
Noise	When run by an inverter, a general-purpose motor generates noise slightly greater than with commercial power.
Vibration	When run by an inverter at variable speeds, the motor may generate vibration, especially because of (a) unbalance of the rotor including a connected machine, or (b) resonance caused by the natural vibration frequency of a mechanical system. Particularly, be careful of (b) when operating at variable speeds a machine previously fitted with a constant speed motor. Vibration can be minimized by (1) avoiding resonance points using the frequency jump function of the inverter, (2) using a tireshaped coupling, or (3) placing a rubber shock absorber beneath the motor base.
Power transmission mechanism	Under continued, low-speed operation, oil lubrication can deteriorate in a power transmission mechanism with an oil-type gear box (gear motor) or reducer. Check with the motor manufacturer for the permissible range of continuous speed. To operate at more than 60Hz, confirm the machine's ability to withstand the centrifugal force generated.

### Application to special motors

Gear motor	The allowable rotation range of continuous drive varies depending on the lubrication method or motor manufacturer. (Particularly in case of oil lubrication, pay attention to the low frequency range.)
Brake-equipped motor	For use of a brake-equipped motor, be sure to connect the braking power supply from the primary side of the inverter.
Pole-change motor	There are different kinds of pole-change motors (constant output characteristic type, constant torque characteristic type, etc.), with different rated current values. In motor selection, check the maximum allowable current for each motor of a different pole count. At the time of pole changing, be sure to stop the motor. Also see: Application to the 400V-class motor.
Submersible motor	The rated current of a submersible motor is significantly larger than that of the general-purpose motor. In inverter selection, be sure to check the rated current of the motor.
Explosion-proof motor	Inverter drive is not suitable for a safety-enhanced explosion-proof type motor. The inverter should be used in combination with a pressure-proof explosion-proof type of motor. *Explosion-proof verification is not available for SJ700 / SJ700B Series.
Synchronous (MS) motor High-speed (HFM) motor	In most cases, the synchronous (MS) motor and the high-speed (HFM) motor are designed and manufactured to meet the specifications suitable for a connected machine. As to proper inverter selection, consult the manufacturer.
Single-phase motor	A single-phase motor is not suitable for variable-speed operation by an inverter drive. Therefore, use a three-phase motor.

### Application to the 400V-class motor

A system applying a voltage-type PWM inverter with IGBT may have surge voltage at the motor terminals resulting from the cable constants including the cable length and the cable laying method. Depending on the surge current magnification, the motor coil insulation may be degraded. In particular, when a 400V-class motor is used, a longer cable is used, and critical loss can occur, take the following countermeasures:

- (1) install the LCR filter between the inverter and the motor,
- (2) install the AC reactor between the inverter and the motor, or
- (3) enhance the insulation of the motor coil.

## Notes on Use

### Drive

Run/Stop	Run or stop of the inverter must be done with the keys on the operator panel or through the control circuit terminal. Do not operate by installing a electromagnetic contactor (MC) in the main circuit.
Emergency motor stop	When the protective function is operating or the power supply stops, the motor enters the free run stop state. When an emergency stop is required or when the motor should be kept stopped, use of a mechanical brake should be considered.
High-frequency run	A max. 400Hz can be selected on the SJ700 / SJ700B Series. However, a two-pole motor can attain up to approx. 24,000 rpm, which is extremely dangerous. Therefore, carefully make selection and settings by checking the mechanical strength of the motor and connected machines. Consult the motor manufacturer when it is necessary to drive a standard (general-purpose) motor above 60Hz. A full line of high-speed motors is available from Hitachi.

### About the load of a frequent repetition use

About frequent repetition use (crane, elevator, press, washing machine), a power semiconductor (IGBT, a rectification diode, thyristor) in the inverter may come to remarkably have a short life by thermal fatigue.  
The life can be prolonged by lower a load electric current. Lengthen acceleration / deceleration time. Lower carrier frequency. or increasing capacity of the inverter.

### About the use in highlands beyond 1,000m above sea level

Due to the air density decreasing, whenever standard inverters are used for altitudes above 1000m, the following conditions are additionally required for proper operation. In application for operation over 2500m, kindly contact your nearest sales office for assistance.

1. Reduction of inverter rated current  
Current rating has to be reduced 1% for every 100m that exceeds from an altitude of 1000m.  
For example, for inverters placed at an altitude of 2000m, the rated current has to be reduced 10% (Rated current x0.9) from its original amount.  
{(2000m-1000m)/100m\*1%=10%}
2. Reduction of breakdown voltage  
Whenever an inverter is used at altitudes beyond 1000m, the breakdown voltage decreases as follows:  
1000m or less: 1.00 / 1500m: 0.92 / 2000m: 0.90 / 2500m: 0.85. As mentioned in the instruction manual, please avoid any pressure test.

## Installation location and operating environment

Avoid installation in areas of high temperature, excessive humidity, or where moisture can easily collect, as well as areas that are dusty, subject to corrosive gasses, mist of liquid for grinding, or salt. Install the inverter away from direct sunlight in a well-ventilated room that is free of vibration. The inverter can be operated in the ambient temperature range from -10 to 50°C. (Carrier frequency and output current must be reduced in the range of 40 to 50°C.)

## Main power supply

Installation of an AC reactor on the input side	<p>In the following examples involving a general-purpose inverter, a large peak current flows on the main power supply side, and is able to destroy the converter module. Where such situations are foreseen or the connected equipment must be highly reliable, install an AC reactor between the power supply and the inverter. Also, where influence of indirect lightning strike is possible, install a lightning conductor.</p> <p>(A) The unbalance factor of the power supply is 3% or higher. (Note)</p> <p>(B) The power supply capacity is at least 10 times greater than the inverter capacity (the power supply capacity is 500 kVA or more).</p> <p>(C) Abrupt power supply changes are expected.</p> <p>Examples:</p> <p>(1) Several inverters are interconnected with a short bus.</p> <p>(2) A thyristor converter and an inverter are interconnected with a short bus.</p> <p>(3) An installed phase advance capacitor opens and closes.</p> <p>In cases (A), (B) and (C), it is recommended to install an AC reactor on the main power supply side.</p> <p>Note: Example calculation with <math>V_{RS} = 205V</math>, <math>V_{ST} = 201V</math>, <math>V_{TR} = 200V</math>  <math>V_{RS}</math> : R-S line voltage, <math>V_{ST}</math> : S-T line voltage, <math>V_{TR}</math> : T-R line voltage</p> $\text{Unbalance factor of voltage} = \frac{\text{Max. line voltage (min.)} - \text{Mean line voltage}}{\text{Mean line voltage}} \times 100$ $= \frac{V_{RS} - (V_{RS} + V_{ST} + V_{TR})/3}{(V_{RS} + V_{ST} + V_{TR})/3} \times 100 = \frac{205 - 202}{202} \times 100 = 1.5(\%)$
Using a private power generator	<p>An inverter run by a private power generator may overheat the generator or suffer from a deformed output voltage waveform of the generator. Generally, the generator capacity should be five times that of the inverter (kVA) in a PWM control system, or six times greater in a PAM control system.</p>

## Notes on Peripheral Equipment Selection


Wiring connections		(1) Be sure to connect main power wires with R(L1), S(L2), and T(L3) terminals (input) and motor wires to U(T1), V(T2), and W(T3) terminals (output). (Incorrect connection will cause an immediate failure.) (2) Be sure to provide a grounding connection with the ground terminal ( ⊕ ).
Wiring between inverter and motor	Electromagnetic contactor	When an electromagnetic contactor is installed between the inverter and the motor, do not perform on-off switching during running operation.
	Thermal relay	When used with standard applicable output motors (standard three-phase squirrel-cage four-pole motors), the SJ700/SJ700B Series does not need a thermal relay for motor protection due to the internal electronic protective circuit. A thermal relay, however, should be used: • during continuous running outside a range of 30 to 60 Hz. • for motors exceeding the range of electronic thermal adjustment (rated current). • when several motors are driven by the same inverter; install a thermal relay for each motor. • The RC value of the thermal relay should be more than 1.1 times the rated current of the motor. Where the wiring length is 10 m or more, the thermal relay tends to turn off readily. In this case, provide an AC reactor on the output side or use a current sensor.
Installing a circuit breaker		Install a circuit breaker on the main power input side to protect inverter wiring and ensure personal safety. Choose an inverter-compatible circuit breaker. The conventional type may malfunction due to harmonics from the inverter. For more information, consult the circuit breaker manufacturer.
Wiring distance		The wiring distance between the inverter and the remote operator panel should be 20 meters or less. Shielded cable should be used on the wiring. Beware of voltage drops on main circuit wires. (A large voltage drop reduces torque.)
Earth leakage relay		If the earth leakage relay (or earth leakage breaker) is used, it should have a sensitivity level of 15 mA or more (per inverter).
Phase advance capacitor		Do not use a capacitor for power factor improvement between the inverter and the motor because the high-frequency components of the inverter output may overheat or damage the capacitor.

## High-frequency Noise and Leakage Current

- (1) High-frequency components are included in the input/output of the inverter main circuit, and they may cause interference in a transmitter, radio, or sensor if used near the inverter. The interference can be minimized by attaching noise filters (option) in the inverter circuitry.
- (2) The switching action of an inverter causes an increase in leakage current. Be sure to ground the inverter and the motor.

## Lifetime of Primary Parts

Because a DC bus capacitor deteriorates as it undergoes internal chemical reaction, it should normally be replaced every five years. Be aware, however, that its life expectancy is considerably shorter when the inverter is subjected to such adverse factors as high temperatures or heavy loads exceeding the rated current of the inverter. The approximate lifetime of the capacitor is as shown in the figure at the right when it is used 12 hours daily (according to the "Instructions for Periodic Inspection of General-Purpose Inverter" (JEMA).) Also, such moving parts as a cooling fan should be replaced. Maintenance inspection and parts replacement must be performed by only specified trained personnel. Please plan to replace new INV depends on the load, ambient condition in advance.



## Precaution for Correct Usage

- Before use, be sure to read through the Instruction Manual to insure proper use of the inverter.
- Note that the inverter requires electrical wiring; a trained specialist should carry out the wiring.
- The inverter in this catalog is designed for general industrial applications. For special applications in fields such as aircraft, outer space, nuclear power, electrical power, transport vehicles, clinics, and underwater equipment, please consult with us in advance.
- For application in a facility where human life is involved or serious losses may occur, make sure to provide safety devices to avoid a serious accident.
- The inverter is intended for use with a three-phase AC motor. For use with a load other than this, please consult with us.

Information in this brochure is subject to change without notice.

